

**SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards**

DEVELOPMENT CODE REVISIONS CHAPTER 5¹			
CASE #	RESO #	SECTION/DESCRIPTION	DATE
94-165	95-51	ENTIRE CHAPTER	06/12/95
99-74	99-166	5600	12/20/99
99-174	00-86	5102.07	8/14/00
03-053	03-75	Entire Chapter	8/11/03
04-077	07-44	Comprehensive Amendments to the Code	5/22/07
10-143	13-74	Entire Chapter	10/8/13

¹ The Sections referenced above were the Sections in effect at the time the Development Code was amended. Subsequent amendments to the Development Code may have resulted in section numbers being modified and may no longer be applicable.

**SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards**

**TABLE OF CONTENTS
CHAPTER 5**

5000: INTRODUCTION	6
5001: Purpose and Intent	6
5002: Authority	6
5003: Types of Roads	6
5003.01: Publicly Owned and Maintained Roads	6
5003.02: Publicly Owned Roads Maintained by Others	6
5003.03: County Maintained Roads, Owned by Others	6
5003.04: Privately Owned and Maintained Roads and Recreational Pathways	7
5004: Road Numbering & Naming	7
5005: Application of Standards	7
5006: Upgrading of Existing County Roads and Recreational Pathways	7
5006.01: Upgrading Needed to Accommodate New Development	7
5006.02: Upgrading Requested by Property Owners	7
5007: Construction of New Roads and Recreational Pathways	8
5007.01: New Roads and Recreational Pathways to be Built by Developers	8
5007.02: New Roads and Recreational Pathways to be Built by the County	8
5008: Permits for Road, Bridge and Recreational Pathway Construction	8
5009: Right-of-Way Vacations	8
5100: ROAD, BRIDGE AND RECREATIONAL PATHWAY DESIGN CRITERIA	9
5101: Purpose and Intent	9
5102: Road Classifications	9
5102.01: Principle Arterials	9
5102.02: Arterials	9
5102.03: Collectors	9
5102.04: Local Access Roads	9
5102.05: Low Volume	9
5102.06: Primitive Roads	10
5102.07: Backcountry Roads and Driveways	10
5103: Road Design	10
5103.01: Future Planning	10
5103.02: General Design Elements	10
5103.03: Specific Design Elements	11
5103.04: Payment of Costs for New Road Construction	15
5104: Upgrading Existing Roads	16
5104.01: Design Standards	16
5105: Bridge Design	16
5105.01: Design Standards for Bridges	16
5105.02: Payment of Bridge Construction Costs	16
5106: Traffic Safety	16
5106.01: Guardrails	16
5106.02: Traffic Control Devices	17
5106.03: Sight Distance Triangle	17
5106.04: Aboveground Utility Location	18
5106.05: Rural Free Delivery Multi Box Modules	19
5106.06: Individual Mailboxes	19
5107: Driveways and Parking Areas	20
5107.01: Requirement for Access Permit	20

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

5107.02: Requirement for Grading Permit	20
5107.03: Standards for Driveway Design	20
5107.04: Standards for Parking Areas	22
5108: Landscaping.....	23
5109: Recreational Pathways & Trails.....	23
5200: ROAD, BRIDGE AND RECREATIONAL PATHWAY CONSTRUCTION SPECIFICATIONS	26
5201: Purpose and Intent	26
5202: Closing of Streets, Roads and Recreational Pathways	26
5202.01: Notice and Operation of Road Closure.....	26
5203: Construction of Roads and Recreational Pathways.....	26
5203.01: Permits Required for Road and Recreational Pathway Construction.....	26
5203.02: Construction Inspection and Testing Requirements for Road and Recreational Pathway Construction.....	26
5203.03: Site Preparation.....	27
5203.04: Structural Embankment Construction	27
5203.05: Trench Excavation	28
5203.06: Culverts.....	29
5203.07: Subgrade.....	30
5203.08: Gravel Roads.....	30
5203.09: Hot Mix Asphalt Pavements	30
5300: ACCESS PERMIT REQUIREMENTS.....	34
5301: Purpose and Intent	34
5302: Procedures/Requirements for Issuance of Access Permits.....	35
5302.01: Submittal Requirements for Access Permits	35
5302.02: Action on Access Permits	35
5302.03: Construction Specifications for Access Work.....	35
5302.04: Construction Schedule for Access Work.....	35
5302.05: Supervision of Access Work.....	35
5302.06: Inspection and Testing of Access Work	36
5302.07: Responsibility for Rework on Access Connections	36
5400: RIGHT-OF-WAY PERMIT REQUIREMENTS.....	36
5401: Purpose and Intent	36
5402: Requirements for Financial Guarantee	36
5403: Procedures/Requirements for Issuance of Right-of-Way Permits	37
5403.01: Submittal Requirements for Right-of-Way Permits.....	37
5403.02: Action on Right-of-Way Permits	37
5403.03: Construction Specifications and Schedule for Right-of-Way or Recreational Pathway Easement Work.....	38
5403.04: Emergencies.....	38
5403.05: Expiration of Permits	38
5404: Fines and Penalties.....	38
5405: Procedures for Road or Recreational Pathway Closures During Right-of-Way or Recreational Pathway Easement Work.....	38
5406: Protection of Public Safety and Convenience	38
5407: Construction Procedures for Right-of-Way or Recreational Pathway Easement Work.....	39
5407.01: Compliance with Safety Standards.....	39
5407.02: Staging of Installations	39
5407.03: Installation of Utilities	39

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

5407.04: Trenching, Backfill and Reconstruction of Road or Recreational Pathway Surfaces	40
5408: Inspection and Testing of Right-of-Way or Recreational Pathway Easement Work	40
5409: Responsibility for Corrective Work Upon Completion of Right-of-Way or Recreational Pathway Easement Work	41
5410: Guarantee Period for Right-of-Way or Recreational Pathway Easement Work	41
5411: Changes Affecting Utilities	41
5500: ROAD ACCEPTANCE AND MAINTENANCE	41
5501: Purpose and Intent	41
5502: Maintenance Categories	42
5502.01: Full Maintenance	42
5502.02: Probationary Maintenance	42
5502.03: Provisional Maintenance	42
5502.04: No Maintenance	42
5503: Assumption of Road Maintenance	42
5504: Acceptance Procedure for Roads and Recpaths Constructed by Developers and Proposed for Acceptance by the County	43
5504.01: Design Review	43
5504.02: Inspections	43
5504.03: Filing Request for County Acceptance	43
5504.04: Staff Evaluation and Recommendation	44
5504.05: Board of County Commissioners Action on Request for Acceptance	44
5504.06: Guarantee Period After Probationary Acceptance	44
5504.07: Final Acceptance	44
5505: Acceptance of Private Roads or Recpaths for Maintenance	44
5505.01: Filing Request for County Acceptance	44
5505.02: Staff Evaluation and Recommendation	44
5505.03: Board of County Commissioners Action on Request for Acceptance	45
5505.04: Final Acceptance	45
5506: Acceptance Procedure for Roads Constructed Through a Local Improvement District	45
5506.01: Design and Construction Standards for Local Improvement Districts	45
5506.02: Construction Supervision for Local Improvement Districts	45
5506.03: Staff Evaluation and Recommendation	45
5506.04: Board of County Commissioners Action on Request for Acceptance	45
5507: Responsibilities for Road Maintenance	45
5507.01: Providing for Parking	46
5507.02: Providing for Drainage	46
5507.03: Keeping Right-of-Way or Recreational Pathway Easement Clear	46
5507.04: Repairing Damage	46
5600: VARIANCES FROM DESIGN AND CONSTRUCTION STANDARDS	46
5601: Circumstances when a Variance may be considered	46
5602: Considerations for Decision on Variances	47
5700: ENFORCEMENT OF DESIGN AND CONSTRUCTION STANDARDS	47
5701: Enforcement when Subdividing Property	47
TABLES and FIGURES	48
TABLE 5-1 Design Capacity for Classes of Roadways	48
TABLE 5-2 Summary of Road Design Elements	48

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

TABLE 5-3	Minimum Structural Sections.....	49
TABLE 5-4	Coefficient of Runoff.....	50
TABLE 5-5	Maximum Permissible Velocities.....	50
TABLE 5-6	Driveway Criteria.....	51
TABLE 5-7	Gradations for Gravel Roads.....	52
TABLE 5-8	Gradations for Base Course Material.....	52
TABLE 5-9	Minimum Discharge and Delivery Temperatures.....	53
TABLE 5-10	Minimum Air and Surface Temperatures.....	53
FIGURE 5-1	Typical Cross-section of Arterial and Collector Roads.....	54
FIGURE 5-2	Typical Cross-sections for Local Access Road.....	55
FIGURE 5-3	Typical Cross-sections for Low Volume Roads.....	56
FIGURE 5-4	Typical Cross-sections for Primitive Road.....	57
FIGURE 5-5	Typical Section of Recreational Pathway.....	58
FIGURE 5-6	Hammerhead and Cul-de-Sac Typical Minimum Designs.....	59
FIGURE 5-7	Sight Distance Triangle.....	60
FIGURE 5-8	Minimum Requirements for Utility Trench Backfill.....	61
FIGURE 5-9	Acceptable Culvert Installations.....	62
FIGURE 5-10	Sample Single Mailbox Approved Design.....	63
FIGURE 5-11	Typical Drainage Pan Detail.....	64
FIGURE 5-12	Indemnification Agreement.....	65

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE

CHAPTER 5: Road & Bridge Standards

5000: INTRODUCTION

5001: Purpose and Intent

The Summit County Road & Bridge Standards (“Road Standards”) establish a uniform road development policy throughout Summit County and provide a clear statement of the procedures for road, bridge and recreational pathway (“recrepath”) construction. The purpose and intent of these policies and procedures is to provide safe attractive travel corridors, efficient traffic flow and efficient maintenance.

5002: Authority

The State of Colorado, by statute, authorizes the Board of County Commissioners (“BOCC”) to administer the County road system including, but not limited to, maintenance, layout, alterations, deletions, additions, specifications, property acquisition and traffic regulation. The Engineering Department enforces road construction standards, reviews plans and conducts inspections. The Road & Bridge Department maintains and improves roads accepted by Summit County, administers work within public rights-of-way, reviews plans and conducts inspections.

5003: Types of Roads

The roads contained in the countywide circulation system can be categorized based on whether the road right-of-way is public or private and whether the County or another party is responsible for maintenance. These categories are described below.

5003.01: Publicly Owned and Maintained Roads

Under this category, the County has an interest of record or other claim to the road right-of-way and has assumed responsibility for the road maintenance. These roads are listed in the annual inventory filed with the State of Colorado, and the County receives an annual allotment of highway users’ fees to defray maintenance costs based on the mileage of roads listed.

5003.02: Publicly Owned Roads Maintained by Others

In certain cases private property owners using public roads for access desire a higher level of service than the County can provide. In such cases, the County and the property owners have reached an agreement assigning maintenance responsibilities to the property owners. The primary examples of this situation are in the Keystone Resort and the Buffalo Mountain Metro District. In other cases, publicly-owned roads might be maintained by an adjacent town. Such arrangements have been made when it makes more sense for the town to plow a portion of a County road because of its location and its connection to town streets. In still other cases there are public roads that have not been accepted for maintenance by the County. In these latter cases the roads provide public access but the responsibility for maintenance of those roads falls to the users of the road(s), either because they do not meet County standards or applications for County maintenance have not been received or approved. In cases where roads are not maintained by the County, the owners or some other agency may wish to establish a Public Improvement District (“PID”) pursuant to C.R.S. Section 30-20-500 et seq. in order to provide for equitable sharing of costs and a formally established standard of maintenance and condition of the road(s). Although the County may not maintain a road, all public roads and associated rights-of-way are still managed and regulated by the County according to the standards promulgated herein.

5003.03: County Maintained Roads, Owned by Others

A number of county roads include segments that cross National Forest lands. These segments are owned by the federal government and continued public access may be authorized through an administrative process such as the County’s master special use permit for roadways. In certain circumstances, the County assumes maintenance of these road segments.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE

CHAPTER 5: Road & Bridge Standards

In addition, this category includes town streets plowed by the County by agreement and privately owned roads historically maintained by the County for various reasons.

5003.04: Privately Owned and Maintained Roads and Recreational Pathways

This category includes all roads and recpaths where a private party has ownership of the road right-of-way either through a deed, easement, covenants or other interest, and is responsible for the road maintenance. Any new development within Summit County requires the right-of-way to be dedicated to Summit County.

5004: Road Numbering & Naming

All public and private roads within the County have been assigned a County Road Number. The numbers are used for identification purposes to help speed emergency services and to assist in locating utilities. The fact that a County Road is assigned a number does not necessarily mean the road is maintained by the County. All proposed names for new or existing roads must be reviewed and approved by the IS Department to ensure that all road names are unique and do not duplicate existing road names.

5005: Application of Standards

All new road, bridge, and recpath construction or upgrades, whether they are maintained publicly or privately, shall adhere to the current Road & Bridge Standards unless a variance is granted in accordance with Section 5600 et seq.

5006: Upgrading of Existing County Roads and Recreational Pathways

5006.01: Upgrading Needed to Accommodate New Development

For the purposes of this section and when considering the need for upgrading existing County roads, new “development” shall have the meaning contained in Chapter 15 and shall include but not be limited to the creation or rezoning of residential, commercial and industrial properties, as well as mining/milling, logging and recreational activities. Where new development is proposed along existing County roads the developer’s proposal may, at the discretion of the County Engineer, be required to include a traffic impact study which shall include an analysis of the projected traffic volumes, along with information on existing road widths, curves, intersections and surface drainage. The study shall be performed, by a licensed engineer, knowledgeable in traffic engineering, at the expense of the proponent and in compliance with the directives of the Summit County Engineering Department. The County Engineer shall review this information and recommendations shall be made as to what improvements are necessary to accommodate the additional traffic to be generated by the new development. All plans and specifications for upgrading existing roads and recpaths shall be prepared by a Colorado Licensed Professional Engineer who shall issue a statement of substantial compliance and completion of work per the approved design before any release of financial guarantees covering road improvements is granted by Summit County.

These standards establish maximum traffic volumes for certain classifications of roadways (see Table 5-1). If a proposed development will cause these maximum limits to be exceeded on the adjacent roads providing access between the development and the State Highway System, the developer shall be responsible for the cost of improving the affected roads to a classification where the maximum is not exceeded, unless otherwise provided for by the Code (see Section 5104 for methods of payment.) In calculating whether the maximum limits will be exceeded, the cumulative traffic volume based on surrounding land uses and approved zoning, as well as counts of existing traffic levels shall be used.

5006.02: Upgrading Requested by Property Owners

In many instances, roads and recpaths in older subdivisions in Summit County are substandard because they were built prior to the County having an adequate system for enforcing road design and construction standards. Most of these roads and recpaths are too steep or too narrow for the County to maintain. Upgrading existing roads and recpaths within a subdivision to correct these problems shall be at the expense of the property owners served by such

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

roads and repaths. Upon request of the property owners, and pursuant to C.R.S Section 30-20-600 et seq. the County may assist in the formation of a Local Improvement District (LID). Such districts allow for the sale of tax-exempt bonds to finance construction of the improvements over a fixed period of time, usually ten (10) years. Completion of the improvements does not in itself constitute County acceptance for maintenance (see Section 5506 for acceptance procedures for roads and repaths constructed through LIDs).

5007: Construction of New Roads and Recreational Pathways

5007.01: New Roads and Recreational Pathways to be Built by Developers

For purposes of this section, a developer shall be defined as any person engaging in development, including but not limited to: an individual, a group of individuals, a partnership, a corporation, a company or other business entity. Where new roads and repaths are proposed to be built by a developer, the developer's proposal shall include:

- A. An analysis of the projected traffic volumes,
- B. Information on topography,
- C. Information on surface drainage,
- D. Extent of cuts and fills, and
- E. Construction plans and specifications.

All plans and specifications for new roads and repaths shall be prepared by a Colorado Licensed Professional Engineer. Prior to the release of any financial guarantees for road and/or repath construction, a Colorado Licensed Professional Engineer shall provide a statement of completion in compliance with the approved plans and specifications.

The road design and construction specifications shall be reviewed and approved by the County Engineer in conjunction with the preliminary plat, or if no plat is required, prior to issuance of a permit for the improvements. If a plat is required, actual construction of roads and repaths cannot occur until the final plat is approved by the BOCC. The entire cost of any road or repath required to serve new development shall be borne by the developer.

5007.02: New Roads and Recreational Pathways to be Built by the County

Plans and specifications for roads and repaths to be built by the County shall adhere to the road design and construction standards contained in these regulations, and shall be reviewed and approved by the County Engineer prior to commencement of construction.

5008: Permits for Road, Bridge and Recreational Pathway Construction

Prior to the commencement of construction or reconstruction of any road, bridge or repath improvements, or work within public road rights-of-way, the project proponent must obtain at least one of the following permits as determined by the County:

- A. An access permit (Section 5300 of these regulations).
- B. A right-of-way permit (Section 5400 of these regulations).
- C. A grading permit (Section 6000 of this Code).

5009: Right-of-Way Vacations

Any party wishing to initiate a right-of-way or public access easement vacation must apply to the County Engineering Department. The application must include a complete and accurate legal description, signatures of any adjacent landowners affected by the vacation and signoffs from utility companies. Notice to all interested parties shall be mailed, and the BOCC shall consider the request at an announced time and place in accordance with the Public Hearing provisions established in Chapter 13 of this Code. Right-of-way vacations shall be reviewed according to the statutory provisions and procedures established in C.R.S. Section 43-2-301 et seq., as amended.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

5100: ROAD, BRIDGE AND RECREATIONAL PATHWAY DESIGN CRITERIA

5101: Purpose and Intent

This section sets forth specific standards for roadway, bridge and reconfig design in Summit County and is intended for use by design engineers.

5102: Road Classifications

County roads are classified according to function. Functional classifications shall be established by the County Engineer, who hereby has the authority to determine which classification applies to any given road. Criteria used to design roadways are based on their functional classification. For planning purposes, Summit County uses the following functional categories in classifying its roads:

5102.01: Principle Arterials

A principle arterial is a continuous access-controlled road that serves corridor movements having trip length and travel density characteristics indicative of statewide travel. All principle arterials in Summit County are administered by the Colorado Department of Transportation (CDOT).

5102.02: Arterials

Arterials link cities, larger towns and other traffic generators such as major resort areas and provide a means of intra-county travel. Arterials should provide for relatively high overall travel speeds with minimum interference to through movements. The Summit County arterials are Swan Mountain Rd (SCR 1), Montezuma Rd (SCR 5), Dam Rd (SCR 7), Ute Pass Rd (SCR 15), and Boreas Pass Rd (SCR 10).

5102.03: Collectors

Collectors provide a link between local roads and arterials, and allow for the movement of through traffic in neighborhoods. Collectors should be designed so they do not disrupt the activities and land uses they serve. In addition, access to collectors should be designed so as to minimize interruption of traffic flows. Examples of Summit County collectors include but are not limited to SCR 3 (as Barton Rd, Coyne Valley Rd and Ski Hill Rd), Baldy Rd (SCR 520), Ryan Gulch Rd (SCR 1260), Wilderndst Rd (SCR 1255), Huron Rd (SCR 450), Cove Blvd (SCR 120)/Summit Drive (SCR 121), and Little Beaver Trl (SCR 50).

5102.04: Local Access Roads

Local access roads provide direct access to, and connections between, individual residences, businesses, community facilities and other land uses within neighborhoods. They also link individual properties to the collectors and arterial roadway network. This type of road is for use by property owners, the general public and service vehicles such as trash trucks, delivery trucks and snowplows. Roads serving neighborhoods that have been or are proposed to be subdivided into lots of less than 20 acres in size must meet, at a minimum, local access standards. Where a subdivision includes lots of differing sizes such that some are less than 20 acres and some are more than 20 acres, the roads shall meet the more stringent standard. Roads serving neighborhoods where lot sizes are at least 20 acres and projected traffic volumes for these roads exceed 500 trips per day shall also meet local access standards.

5102.05: Low Volume

Low volume roads provide direct access to individual properties within the Agricultural zone district (A-1) that have been or are proposed to be subdivided into individual parcels of 20 acres or larger and the Average Daily Traffic (ADT) does not exceed 500. Low volume roads provide connections from these areas to roads with higher functional classifications. When an area in the A-1 zone district is proposed to be subdivided into lots of 20 acres or larger, the County Engineer shall consider potential future uses of the property, and of adjacent properties, in

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE

CHAPTER 5: Road & Bridge Standards

projecting traffic volumes, and may require a higher standard for road design if necessary to accommodate future traffic volumes and to implement a coordinated, functional road system.

5102.06: Primitive Roads

A primitive road is a single or two-lane road providing direct access to undeveloped areas, ranches, recreational and scenic areas. This type of road shall not be used to provide access to subdivided property.

5102.07: Backcountry Roads and Driveways

Road and driveway improvements and maintenance are limited to the primitive road classification in areas within the Backcountry (BC) Zoning District. Please refer to Sections 3514.03 and 3514.05.C for specific requirements regarding road and driveway standards and limitations on maintenance and improvements in the Backcountry Zone.

5103: Road Design

A Colorado Licensed Professional Engineer shall prepare all road designs, plans and specifications.

5103.01: Future Planning

Prior to commencing with the design of a new road or an upgrade of an existing road, projections of future development and densities, estimates of future traffic volumes, appropriate classifications and design speeds must be determined. The road classification determines the geometric cross section and maximum sustained grades, while the design speed determines minimum or maximum standards for elements of alignment such as stopping and passing sight distances, radii of curvature, tangent lengths and superelevation transition lengths. Standard structural sections or designed structural sections may be used.

- A. **Design Period:** Roadway design will be based on the projected needs 20 years after construction.
- B. **Projected Development:** Projections of development over the design period will be based on the County Master Plan in effect and on zoning, existing land use, proximity to developed areas, historic growth and other factors which can be expected to influence development.
- C. **Projected Traffic Volumes:** Design engineers shall use the most recent edition of the Trip Generation manual published by the Institute of Transportation Engineers to obtain appropriate ADT counts for any proposed development.

5103.02: General Design Elements

- A. **Design Capacities:** Table 5-1 presents the range of ADTs anticipated for each type of road. If traffic volumes on a particular road exceed the range specified for its functional category, the road shall be reclassified to the appropriate category. However, roads may carry lower volumes than stated for their functional category without being reclassified. In such cases, the function of the road rather than traffic volumes will determine design requirements.
- B. **Design Speed:** Principally the character of terrain, traffic volumes and appropriate range of design speeds for each road classification influence the selection of design speed. Design speed shall be a minimum of five (5) miles per hour (mph) over the posted or proposed speed limit.
- C. **Surfacing Requirement:** All roads serving areas with projected densities of two (2) units per acre or greater, or expected to carry an ADT of 700 or greater, must be paved. Other roads may have a gravel or paved surface.
- D. **Right-of-Way:** The minimum right-of-way widths required for each road classification are specified in Table 5-2. Additional right-of-way shall be provided for drainage improvements, cuts or fills, intersections, curb returns, snow storage and other road appurtenances if required, as determined by the County Engineer.
- E. **One-Way Roads:** One-way roads may be allowed by the County Engineer if the following potential issues can be mitigated:
 - 1. Property owners at the far end of a one way loop road tend to take short cuts and drive the wrong way to

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

- reach their properties, thus increasing the chances for accidents.
 - 2. Emergency vehicles must, in certain cases, take a more circuitous route to reach their destination.
 - 3. One-way roads can cause confusion for people not familiar with the area.
 - 4. In winter, snowplowing often reduces the driving surfaces of roads because snow accumulates along the edges. On one-way roads, this reduction may pose a serious safety problem because it hampers access for emergency vehicles and limits the area available for their operation.
- F. **Striping:** Paved roads may be striped with appropriate centerline and shoulder stripes per the most recent edition of the Manual on Uniform Traffic Control Devices (MUTCD) and CDOT Standard S-627-1. This specification shall apply to collector and higher functional classification roads or other roads as determined necessary by the County Engineer.

5103.03: Specific Design Elements

A. **Alignment:** The major considerations in alignment design are safety, grade, profile, road width, design speed, sight distance, topography, drainage and the maneuverability, braking and performance of heavy duty vehicles. Alignment should provide for safe and continuous operation at a uniform design speed. In high alpine areas, consideration should be given to locating the road so that southern exposure will be maximized to the extent possible. Road layout should bear a logical relationship to existing or platted roads in adjacent properties and to the principles of good engineering practice. All roads shall be designed such that the roads are centered in the right-of-way.

1. **Horizontal Alignment:**

- a. **Stopping Sight Distance:** Horizontal alignment must provide at least the minimum stopping distance for the design speed at all points. This includes visibility at intersections as well as around curves and roadside encroachments. The minimum stopping sight distance is the distance required by the driver of a vehicle traveling at the design speed to bring the vehicle to stop after an object on the road becomes visible. Stopping sight distance shall be designed in accordance with the standards established in the most recent edition of the American Association of State Highway Transportation Officials' (AASHTO) publication "A Policy on Geometric Design of Highways and Streets" (hereafter PGDHS).
- b. **Passing Sight Distance:** Passing sight distance is the minimum sight distance that must be available to enable the driver of one vehicle to pass another safely and comfortably without interfering with oncoming traffic traveling at the design speed. Two-lane roads should provide adequate passing zones. Required passing sight distance shall be designed in accordance with the standards established in the most recent edition of the PGDHS.
- c. **Curvature:** Curve radii shall be designed in accordance with the practices and standards established in the latest edition of the PGDHS, utilizing a maximum superelevation rate of 6%. Where design superelevation rates over 6% are necessary or appropriate, the plans shall be accompanied by a statement from the design engineer justifying their design, and evidence that the design will not pose a threat of traction loss to slow-moving motorists under icy conditions.
- d. **Curb Returns:** Curb returns or pavement rounding radii at intersection corners are as follows:

Road Class	Curb Return Radius
Local	20 Feet
Collector	30 Feet
Arterial	50 Feet

Additional right-of-way will be required to provide a minimum clear distance of 15 feet between the curb or edge of pavement and the right-of-way limit.

- e. **Intersections:** The minimum distance between intersections, as measured from the inside edge of each right-of-way, for various road classifications is as follows:

Road Class	Distance
Local	200 Feet
Collector	500 Feet
Arterial	1000 Feet

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

2. Vertical Alignment:

- a. **Minimum and Maximum Grades:** Minimum and maximum sustained grades shall be one-half percent (0.5%) and six percent (6%) respectively, except as provided in sub-section b below. Increases in grade will be permitted for sections of road where the horizontal radius of curvature exceeds 1,500 feet.

The maximum limits of grade increase and required conditions are as follows:

- 1% for a distance of 500 feet maximum to a maximum of 7%.
 - 2% for a distance of 200 feet maximum to a maximum of 8%.
- i. No two such sections will be within 500 feet of each other or within 500 feet of a curve having a radius of less than 1,500 feet.
- ii. All grades will flatten to three percent (3%) or less for at least 100 feet approaching intersections. Grades approaching the turnarounds in cul-de-sacs will be four percent (4%) or less for at least 50 feet.
- iii. All distances will be measured from the intersection of the rights-of-way lines.
- iv. The maximum design grade should be used infrequently rather than as a value to be used in most cases.
- b. **Exception to Maximum Grades:** A local access or low volume road may have sections with a grade of up to nine percent (9%) provided all of the following conditions are met:
- i. The section shall be no longer than 500 feet.
 - ii. The section shall have a horizontal radius of 1500 feet or greater.
 - iii. Grades shall not exceed six percent (6%) for 500 feet on either end of the transition to the maximum grade.
 - iv. Curves with a horizontal radius of less than 600 feet shall not be within 500 feet on either end of the section.
 - v. Land on each side of the section must be designated permanent open space.
- c. **Vertical Curves:** Vertical curves must be designed in accordance with the most recent edition of the PGDHS to provide adequate stopping and passing sight distance, headlight distance, driver comfort and drainage.

3. Switchbacks:

A switchback is defined as a curve in a driveway, roadway or other access way with a delta greater than 120 degrees and a radius less than 100 feet.

- a. **Use of Switchbacks:** Switchbacks will not be allowed on new collector or arterial roadways. On local access, low volume or primitive roadways when other alternatives may cause significant adverse impacts, the use of switchbacks may be allowed on a case-by-case basis, with approval from the County Engineer.
- b. **Minimum Standards:** Switchbacks shall be designed with a minimum centerline radius of 60 feet. Maximum centerline grades within 25 feet of a switchback curve and throughout the curve shall not exceed four percent (4%). Curve widening shall be in accordance with Section 5103.03.B.7. Adequate snow storage must be provided.

4. Alignment Coordination:

When vertical and horizontal curves are superimposed, the superlevation may cause distortion in the outer pavement edges. Where this may be the case, edge of pavement profiles shall be plotted and smooth curves introduced to remove any irregularities. Sharp horizontal curves should not be introduced at or near a pronounced summit or sag.

B. Geometric Cross Sections:

1. **Typical Sections:** A typical section for each road classification is shown in Figures 5-1 through 5-4. These typical sections are for use as a guideline in the design of roads, and do not in and of themselves establish any minimum standards or design criteria.
2. **Travel Lane Width:** The minimum travel lane width for major arterials, arterials and collectors is eleven (11) feet, for local access roads is ten (10) feet, and for low volume and primitive roads is ten (10) feet. In addition to the 11-feet of required traveled way width for arterials and collectors, a three (3) foot wide paved shoulder shall be required.
3. **Crown Slope:** On undivided roads in tangent alignment, the high point of the crown will be centered on the pavement and the pavement sloped toward the edges on a uniform grade. In mountainous terrain, unpaved roads will be sloped toward the cut side of the road on a three percent (3%) slope to alleviate

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE

CHAPTER 5: Road & Bridge Standards

surface erosions. On divided multilane roads on tangent alignment, each travelled way will have a uniform cross-slope with the high point at the edge nearest the median. The design crown slope shall be a minimum of 2% for paved roads and 3% for gravel roads.

4. **Superelevation:** To account for snow and ice conditions that occur frequently in Summit County, the maximum superelevation will be limited to 0.06 feet per foot except as approved by the County Engineer per Section 5103.03.A.1 of this Code. The axis of rotation of undivided roadways is usually the centerline. For curves following long, level tangents the axis of rotation may be taken at the inside edge of the pavement. For divided roads with wide medians the axis of rotation shall be the inside edge of pavement. For divided roadways with narrow medians each roadway shall be rotated about the edge adjoining the median strip.
5. **Superelevation Transition:** Superelevation transition is the progression of the roadway from the normal crown section to a fully super elevated section. To meet the requirements of safety and comfort, the length required to effect the transition should be adequate for the likely travel speeds. Transitions shall be designed in accordance with the provisions of the most recent edition of the PGDHS.
6. **Spiral Curves:** Spiral curves may be permitted, if deemed appropriate by the Engineering Department, and where permitted shall be designed according to the provisions of the most recent edition of the PGDHS.
7. **Curve Widening:** Curves will be widened on the inside radius in accordance with the most recent edition of the CDOT Roadway Design Guide or the PGDHS, at the designer's discretion.
8. **Cul-de-Sac Streets; Turnarounds:** Whenever possible, roadway systems shall provide at least two (2) access points to lots platted for development. Cul-de-sac streets shall be avoided. Where cul-de-sac streets are the only alternative, turnarounds shall be provided. Bulb type turnarounds shall have a minimum road surface of 90 feet in diameter and a minimum right-of-way of 150 feet in diameter. An alternative to the bulb type turnaround is the use of a hammerhead turnaround. Figure 5-6 illustrates three acceptable hammerhead configurations.
 - a. The maximum length of roads ending in turnarounds shall be 600 feet in areas with a high wildfire hazard and 1000 feet in all other areas. When a variance from this standard is requested, at least one of the following shall be provided to all residences on the cul-de-sac:
 - i. Central water service.
 - ii. An alternative water supply acceptable to the local fire authority.
 - iii. Monitored residential sprinklers.
 - b. Turnouts may be required when a variance is requested.
 - c. Snow storage shall be provided as shown in Figure 5-6 to keep turnarounds cleared. Dead end roads that do not have turnarounds are not allowed.

C. Structural Sections:

1. **Design Structural Sections:** Structural sections shall be designed for all new roads, driveways or roads being upgraded due to increased traffic. The road structure will be designed in accordance with the most recent edition of the CDOT Pavement Design Manual, or the AASHTO Guide for the Design of Pavement Structures as amended, at the designers discretion.
2. **Minimum Structural Requirements:** The minimum structural sections outlined in Table 5-3 shall be met on all roads in Summit County. All asphalt shall be placed in multiple lifts with each lift being one and one-half (1-1/2) inches minimum and three (3) inches maximum.
3. **Concrete Paving:** Areas where a considerable amount of stopping or starting occurs, such as bus stops or signalized intersections, shall be paved with a designed concrete section to minimize the effects of dynamic loading on the pavement.

D. Drainage:

1. **General:** The primary objective of drainage design is the protection of County roads and property while minimizing the possible flood damage to surrounding properties and structures. It should be emphasized that good drainage is one of the most important factors in road design. It preserves the appearance as well as the level of service of the road while minimizing maintenance costs. Water flowing in a roadside ditch shall be diverted away from the road as quickly as possible. In no case shall water travel in a roadside ditch for a distance greater than 800 feet or have a flow greater than five (5) cubic feet per second with the occurrence of a 25-year frequency storm.
 - a. Culverts under all roads shall be designed to accommodate runoff from a 25-year frequency storm utilizing the maximum available head. The maximum available head shall be determined by the

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

- uppermost water surface elevation chosen such that flood damage to upstream properties is prevented.
- b. Inlets and other facilities draining the road surface shall accommodate the 25-year frequency storm runoff. All roads shall remain free of standing water.
 - c. All drainage installations shall be designed to permit free, unobstructed passage of debris and silt or provide for their deflection and/or collection at a point upstream that will not create an expensive maintenance problem. Sediment basins shall be provided when the possibility of a silting problem may occur downstream. Modification of natural channels or transferring runoff from one (1) basin to another is not permitted except where no reasonable alternative exists and where the proposal has been reviewed and approved by the County Engineer.
 - d. A recurring problem on Summit County roads is ice build-up in winters of little snow. Drainage design shall anticipate areas of potential ice buildup. In areas where this problem is anticipated or has arisen, heat trace, or an alternate solution as determined by the County Engineer, shall be required.
 - e. Where practicable, subsurface drains that drain to daylight and accommodate any off right-of-way drainage problem shall be designed to provide a minimum of 50 feet of overland sheet flow before reaching any roadside ditch. Where this minimum distance cannot be achieved, the location of the discharge to daylight must be approved by the Engineering and/or Road & Bridge Departments.
2. **The following methods may be used for estimating peak flows:**
- a. Runoff from stream flow records.
 - b. HEC software from the United States Army Corps of Engineers (“USACE”).
 - c. The Soil Conservation Service Method TR-55 or TR-20.
 - d. The Rational Method, as follows:

$$Q = CiA$$

where,

Q = runoff in cubic feet/second

C = coefficient of runoff (see Table 5-4)

i = average intensity of rainfall in inch/hour for a duration of the time of concentration

A = drainage area in acres

- The rational method should be used only on areas of less than five (5) acres.
- e. Other software or procedures if approved by the County Engineer.
3. **Culverts:** Culverts shall be located at each natural draw or water course as conditions warrant to prevent excessive accumulation of flow in roadside ditches or along the toe of slopes. To the extent that legal access exists, draws and watercourses shall be cleared of debris for a distance of 100 feet upstream from all culvert inlets. Culverts shall be designed per the CDOT Drainage Design Manual or the FHWA Hydraulic Design of Highway Culverts and with the following criteria:
- a. Inverts at the inlet shall be slightly elevated above the normal flow line in steep or natural draws to avoid plugging by debris. Inlets shall not be elevated in those instances where ponding or accumulation of backwater would be objectionable (stagnation, irrigation ditches, etc.).
 - b. The culvert shall slope downward in the direction of natural flow and be designed to be self-cleaning whenever possible. The outlet shall be designed to prevent discharge on unprotected fills or unstable material or at adverse angles to streams or open channels. Flowlines at outlets of culverts shall be dropped slightly below the culvert invert to allow for unrestricted flow. Riprap at outlets, if used, shall be installed such that sediment will not deposit in the culvert because of a backwater condition. Headwall, riprap or other means of protection are required at inlets or outlets where erosion might occur.
 - c. Corrugated metal pipe or an approved equal as specified by the Road & Bridge Director, his authorized representative, and/or the County Engineer shall be used. Steel pipe shall be asphalt coated where soils are corrosive or other conditions exist that may attack steel. Aluminum or other pipe materials are not permissible for road culverts. HDPE culverts may be used in areas of low to moderate wildfire hazard.
 - d. The minimum diameter for round pipe shall be 18 inches. The minimum rise for squash pipes shall be twelve (12) inches.
 - e. When a battery of pipes is used, a clear spacing of ½ the pipe diameter (one (1) foot minimum, four (4) foot maximum) must be provided between pipes. Minimum and maximum cover, pipe metal gauge and

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

- strength classification shall be as specified in section on culverts (see Section 5203.06).
- f. Cleanout access shall be provided at least every 200 feet for pipes 24 inches in diameter or less and at least every 400 feet for larger pipes. Cleanout access shall also be provided at each angle point and at each change in grade. Flow-fill or some alternate self-compacting or self-hardening fill may be required at the discretion of the Engineering and/or Road & Bridge Departments.
 4. **Open Channels and Ditches:** Open channels shall be designed to accommodate flows anticipated from the 25-year design storm event at a minimum, and to prevent erosion or sediment transportation during such an event. Designs shall follow the guidelines in the CDOT Drainage Design Manual, or other procedure if approved by the County Engineer.
 5. **Subsurface Drainage:** Subgrades subject to poor drainage, underground seepage or a high water table shall be adequately drained for roadbed stabilization. Drains shall be installed to prevent the high ground water level from coming within four (4) feet of the roadway pavement. Perforated pipe shall be used to carry away collected water. French drains that contain no pipe are unacceptable. All subsurface drains shall discharge to daylight or to an approved, engineered infiltration system.
 6. **Inlet Structures:** Curb openings with protection bars are preferred, however the County Engineer may permit other designs. Grates are not permitted where pedestrians, bicycles or debris-laden flows are anticipated.
- E. **Side Slopes:** A licensed engineer qualified in soils analysis shall evaluate and render an opinion on the stability of slopes designed steeper than three to one (3:1). Where heavy snowfall is expected, flatter slopes in cuts on the southern side of the roadway should be used to provide maximum exposure to the sun. Flatter slopes should be used wherever possible to reduce erosion, to decrease maintenance costs, to facilitate plant growth and to provide for safer operation.
1. Transition slopes shall be provided between adjoining cuts and fills. Where cut or fill slopes intersect the original ground surface, the cross section shall be rounded to blend the slope into the natural ground surface.
 2. Where the slope of the original ground approaches two to one (2:1), the embankment shall be contained with a suitable retaining wall to avoid long fill slopes. Side slopes in rock will be based on the stability of the formation. Any side-slopes proposed of native rock shall be evaluated by a geotechnical engineer with experience in rock structures, and all recommendations made by the engineer shall be considered requirements unless explicitly waived by the County Engineer. Retaining walls on the uphill side shall be a minimum of ten (10) feet from the centerline of the adjacent drainage ditch.
 3. Benching of side slopes should be used sparingly and only where they are justified by sound engineering reasons, including the following:
 - a. To stabilize material where benching is more economical than flattening.
 - b. To intercept drainage in long and deep cuts.
 - c. To intercept and store loose material.
- F. **Sidewalks:** Sidewalks shall be required where in the opinion of the County Engineer, the number of pedestrians is sufficient to interfere with traffic, or significant pedestrian usage is anticipated. Where sidewalks are installed, the individual property owners shall be responsible for clearing snow and ice from the sidewalks in front of their property.

5103.04: Payment of Costs for New Road Construction

- A. **Developer Responsibility:** All costs of new road construction in new developments are the responsibility of the developer. The developer is also responsible for constructing the new roads according to the Road Standards.
- B. **Payback Agreements:** During the approval process for a proposed development, the developer may be required to construct a new road or to make improvements to an existing road that also benefits future developments. The BOCC may establish a plan of compensation to the original developer whereby subsequent beneficiaries pay a fair share for the use of those improvements. Such a plan would be administered by the County and made a condition of approval for future benefiting developments. The BOCC shall determine the equitable distribution of benefits and costs.

**SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards**

5104: Upgrading Existing Roads

5104.01: Design Standards

All County roads requiring upgrading or improvement, whether public or private, shall be built in accordance with the Road Standards.

A. Existing Roads Serving New Developments:

1. **Requirement for Upgrading:** Existing County roads serving a new development or an area proposed for either platting or re-platting must be upgraded to the Road Standards when one or more of the following conditions occur:
 - a. The existing roads do not meet the Road Standards for the classification.
 - b. The existing roads meet local access standards, but the projected ADT will exceed 700, thus requiring paving of the roads.
 - c. The existing roads meet local access standards, but the projected ADT exceeds the maximum for local access, thus requiring improvement to collector or arterial status.
2. **Payment of Costs:** The developer shall be responsible for all costs incurred to upgrade existing County roads.
3. **Payback of Costs:** Benefiting property owners along existing roads that must be upgraded shall pay back a fair share of the road improvement costs if, in the judgment of the BOCC, a pay back to the developer is appropriate.

5105: Bridge Design

5105.01: Design Standards for Bridges

- A. Bridge designs shall conform to the standards and specifications in the most recent edition of the CDOT Bridge Design Manual. Plans shall be prepared by a qualified structural engineer and shall be submitted to the County Engineer for review and approval prior to construction. The clear deck width must accommodate the full width of the travel lanes and shoulders of approach roads as prescribed in Table 5-2.
- B. The waterway area shall accommodate a 100-year frequency storm. Where flood studies from the USACE or the Federal Emergency Management Agency (FEMA) are available, bridges shall be designed to accommodate the "Standard Project Flood". A minimum of one (1) foot freeboard is required. Additional freeboard shall be required when debris-laden flows are anticipated.

5105.02: Payment of Bridge Construction Costs

If the design of the roadway serving a new development requires construction of new bridges or upgrading existing bridges, the developer shall be required to pay the cost of such construction. Where construction of a bridge benefits future developments the BOCC may establish a plan of compensation to the original developer whereby future beneficiaries pay a fair share for use of the bridge.

5106: Traffic Safety

5106.01: Guardrails

The County Engineer and/or Road & Bridge Director may require guardrails for new construction or upgrades to existing roads subject to the following guidelines, and the criteria and standards published in the most recent edition of the AASHTO Roadside Design Guide. Guardrails are installed to prevent accidents by delineating the roadbed, to reduce accident severity by deflecting vehicles into safer paths and to increase the rate of deceleration in case of impending collisions with fixed objects.

- A. **Design and Placement on Roadways:** Only State approved guardrails shall be used. The length of guardrail

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE

CHAPTER 5: Road & Bridge Standards

should be planned in multiples of 12.5 feet. No abrupt or projecting ends shall face toward approaching traffic, and delineators shall be installed according to CDOT specifications M-606 et seq. Ordinarily, a guardrail is placed only on the outside of curves.

1. When guardrail is used in conjunction with roadside curbs, the face of the guardrail shall be flush with the face of the curb regardless of shoulder width. This is to prevent the takeoff ramp effect that may overturn a vehicle. When no curb is present, the face of the guardrail shall be installed such that the distance from the edge of the shoulder to the face of the guardrail is maximized.
 2. On curves requiring a reduction in approach speeds, any one of the following conditions suggests installation of guardrail on the outside of the curves should be considered:
 - a. Height of embankment is more than ten (10) feet.
 - b. Side slopes are steeper than three to one (3:1).
 - c. Shoulder or pavement widths are substandard.
 - d. Roadside hazards are present.
 3. Whether on curves or tangents, consideration should be given to the installation of guardrails if there is a history of roadway accidents or if unusually high embankments or steep terrain give motorists a feeling of insecurity.
 4. In areas subject to low visibility or snow and ice conditions, or where traffic speed and volumes are high, guardrail may be needed where its installation would otherwise be questionable under less adverse conditions. In such conditions it is critical to maximize the distance from the traveled way to the face of the guardrail to prevent or minimize deflection of vehicles into oncoming traffic.
 5. Guardrails may also be required under the following conditions:
 - a. An obstruction or sudden constriction in roadway.
 - b. An isolated sharp curve on a roadway otherwise built to higher standards.
 - c. Approaches to bridge piers, abutments, trees or other obstructions.
- B. **Guardrail at Bridge Approaches:** Guardrail should be placed at the ends of all bridges on the right of approaching traffic. Where pedestrians are expected to use the shoulder, a walkway should be provided around the end of the guardrail outside the normal shoulder lines.
- C. **Provisions for Snow Storage:** When guardrails are considered for installation, especially for extended lengths, provision shall be made for adequate snow storage and removal.

5106.02: Traffic Control Devices

- A. All signs, striping, markers, delineators, signals and other traffic control devices must conform to the requirements of the most recent edition of the MUTCD published by the U.S. Department of Transportation Federal Highway Administration, as adopted and amended in conjunction with the County's adoption of the Colorado Model Traffic Code.
- B. All new developments shall be signed and marked in accordance with the MUTCD and such signs and markings shall be installed and paid for by the developer. Requests for nonstandard signs or other devices shall be submitted to the County Engineer along with all data required to support the request and must be approved prior to installation.
- C. Any agency or individual desiring to place a sign or marking in a public right-of-way shall request such sign or marking in writing to the County Engineer. The request will be reviewed by the Engineering and Road & Bridge Departments, and may be permitted at their discretion. Any sign approved shall be installed at the expense of the applicant(s) and subject to a license agreement (if appropriate) indemnifying the County from any damages and explicitly stating the conditions of the approval.

5106.03: Sight Distance Triangle

- A. **Determining Dimensions and Location of Sight Distance Triangles:** For safety and visibility purposes, a sight distance triangle shall be maintained at street intersections and where driveways intersect streets. The distances along the legs of the sight distance triangle shall be measured from the corner or intersection point along the right-of-way lines, or along the edge of driving surface for driveways, as shown in Figure 5-7. Where a road right-of-way is wider than normal or varies in width because it has been expanded to include cut and fill slopes or drainage improvements, the line along which the legs of the sight distance triangle are measured shall

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

be parallel to the roadway at normal right-of-way width for the type of road under consideration. For each intersection, the length of the legs of the triangle shall be determined by the classification of the roadways which form the intersection as follows:

Driveways	10 Feet
Low Volume	30 Feet
Local Access	30 Feet
Collector	50 Feet
Arterial	70 Feet

The length of the legs may be increased by the County Engineer if determined to be necessary, based on standard engineering practices, to promote the public health, safety and welfare. No landscaping or improvements shall be allowed over 3.5-feet tall within the sight distance triangles. Installation of traffic control signs or signals and streetlights are exempt from this regulation.

- B. **Incorporating Requirement for Sight Distance Triangles into Subdivision Design:** Developers shall incorporate the requirement for maintenance of a sight distance triangle at street intersections and intersections of driveways with streets in the design of subdivisions submitted for County review. Particular attention shall be given to the size and shape of corner lots.
- C. **Enforcing Requirement When Building Permits are Issued:**
 - 1. Where a building permit is filed for property which is unplatted or was platted prior to the effective date of these regulations, no building permit shall be issued for a structure which interferes with the maintenance of a sight distance triangle unless application of the requirement would result in peculiar and exceptional practical difficulties to, or exceptional and undue hardship upon, the individual proposing development of the property. The County Engineer shall have authority to waive the requirement for maintenance of a sight distance triangle for such a property.
 - 2. Where a building permit application is filed for property that was platted or re-platted after the effective date of this regulation, no building permit shall be issued for any structure that would interfere with the maintenance of a sight distance triangle required by this regulation.
- D. **Continuing Enforcement of Requirement:** Property owners shall be responsible for maintaining sight triangles free of visual obstructions for that portion of a triangle within the boundaries of their property. When the County Engineer receives a complaint concerning visual obstructions at a particular intersection, the Engineering Department shall be responsible for inspecting the intersection and for taking the following measures:
 - 1. Determining whether the visual obstruction is within the sight triangle for an intersection, and if it is on public or private property.
 - 2. If the visual obstruction is on public property, requesting the appropriate jurisdiction remove the obstruction; if the jurisdiction is the County, requesting assistance from the Road & Bridge Department if needed and supervising removal of the obstruction.
 - 3. If the visual obstruction is on private property, notifying the property owner of the requirement that visual obstructions must be removed within 30 calendar days except as follows:
 - a. If the obstruction is a permanent structure which was built prior to the effective date of this regulation, or was granted a waiver as provided in Section 5106.03.C.1, the property owner shall not be required to remove the structure.
 - b. Where the obstruction is caused by the natural or historic topography of the property, and not by earthwork undertaken by the current property owner or his immediate predecessors, the property owner shall not be required to re-grade his property in order to remove the obstruction.

If the property owner does not comply within 30 calendar days, further enforcement action shall be taken as provided in Section 5700 et seq. of these regulations.

5106.04: Aboveground Utility Location

All aboveground utilities including but not limited to power poles, telephone junction boxes, transformers, etc. shall be located as close to the outside edge of the right-of-way as possible but in no case shall there be less than a ten (10)

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

foot separation between the edge of road shoulder and the utility. However, fire hydrants shall be installed no less than ten (10) feet nor more than 15 feet from the edge of road shoulder. This will eliminate any interference with normal road maintenance operations and increase the safety of the traveling public.

5106.05: Rural Free Delivery Multi Box Modules

- A. In subdivisions where provisions were not specifically made for rural free delivery multi box modules, the homeowners association, or if one does not exist, a designated individual or group from the subdivision shall be responsible for submitting a proposal to the Engineering Department. The submitted proposal shall first consider locations in front of or adjacent to the property owners requesting the installation of a multi box module. Engineering shall evaluate all sites in front of or adjacent to property owners requesting rural mail delivery before evaluating any other sites. In evaluating the proposal, staff shall determine if the proposed site meets all the following criteria:
1. The Postal Service will provide delivery service to the area proposed.
 2. The module shall be a minimum of ten (10) feet from the edge of shoulder of the road.
 3. Adequate space for an eight (8) foot wide by 40-foot long pull off shall be provided.
 4. The pull off shall be constructed per Summit County Road & Bridge Standards.
 5. A minimum sight distance of 250 feet in all directions shall be provided.
 6. The pull off shall not have a grade in excess of three percent (3%).
 7. Adequate space for snow storage and removal within the right-of-way or appropriate snow stack easement shall be provided.
 8. The site shall not adversely impact the normal flow of traffic or the surrounding properties.
- In addition, the following information shall be provided:
- a. If the proposed location is adjacent to private property, the affected property owner(s) shall provide a letter stating they have no objection to the module location.
 - b. A letter signed by the homeowners' association president or other approved individual indemnifying Summit County from any damage that may occur due to road maintenance operations (see Figure 5-12).
- B. Once a site meeting these criteria has been located, the proponents shall have the right-of-way staked by a licensed land surveyor indicating the proposed location of the module and the edge of the right-of-way, unless a survey is deemed unnecessary. The right-of-way shall be staked for a distance of 50 feet on either side of the proposed location of the module. Upon completion of the staking, the Engineering Department, the Road & Bridge Department, and the Postmaster shall inspect the proposed site to ensure all the site requirements are met before giving approval. After approval, staff shall notify all property owners within a minimum of 300 feet of the proposed site and inform them of the request and allow them 14 days to appeal the staff decision. If no appeals are received in the allotted time, staff will inform the proponents by written notice that they can begin construction once they obtain a right-of-way permit (Section 5400 et seq.). In the event of an appeal, staff will schedule a hearing with the BOCC at the next available public hearing for which the required notice can reasonably be published. Property owners originally noticed for the proposed site will be re-noticed for the appeal. Proponents and opponents will have the opportunity to state their arguments supporting their respective positions. The BOCC decision will be final. After construction has been completed, a final inspection shall be done to insure the module was properly installed and the pull off was constructed to County standards. All deficiencies shall be corrected before final approval can be given to start mail service.
- C. The homeowners association or other designated group from the subdivision shall be responsible for all costs associated with the construction of the module and pull off and all future maintenance including snow removal of the pull off area.

5106.06: Individual Mailboxes

Where, in unincorporated Summit County, an owner wishes to install or replace an individual mailbox that serves their residence, that installation must first be approved by the Road & Bridge Department. An example of an approved mailbox design is shown in Figure 5-10. Individual mailboxes on individual properties will not be allowed within new subdivisions requesting rural mail delivery.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

5107: Driveways and Parking Areas

5107.01: Requirement for Access Permit

Whenever a property owner, developer, contractor or other individual proposes to connect a driveway or parking area to a public roadway, they must obtain an access permit from the Engineering Department prior to commencing construction. The submittal requirements and procedure for obtaining access permits are stated in Section 5300 et seq. of this Code.

5107.02: Requirement for Grading Permit

Whenever construction of a road, Recpath, trail, driveway or parking area results in earth disturbance, the individual responsible for the construction must obtain a grading permit from the Engineering Department prior to commencing construction. The submittal requirements and procedure for obtaining grading permits are stated in Section 6300 et seq. of this Code.

5107.03: Standards for Driveway Design

A driveway is an access way for vehicles providing a connection from a public or private roadway to either 1) individual single-family or duplex dwellings; or 2) a parking lot serving multi-family dwellings, commercial development, industrial development or other non-residential development. Driveways under category 1 above may serve no more than four (4) single-family dwellings or two duplex structures (four (4) dwelling units in two (2) duplex structures). If an access way serves more than four (4) individual single-family dwellings, it shall be classified as a roadway rather than a driveway and must meet the County's standards and requirements for road construction. An access way serving a working ranch or farm and any associated residence regardless of length shall be considered a driveway, and shall meet only such standards as are necessary for public health and safety and as outlined in Section 5107.

A. **Location of Driveways Relative to Intersections:** Driveways shall be placed so the following minimum distances are maintained to any street intersection, including a T-intersection on the opposite side of the street from a property where a driveway is proposed:

1. Where the driveway connects to a local access or low volume road, a minimum distance of 50 feet from curve return to edge of right-of-way at the intersection shall be maintained.
2. Where a driveway connects to a collector or larger road, a minimum distance consisting of the left turn stacking distance plus 20 feet as measured from the driveway curve return to the intersection curve return, shall be maintained. The left turn stacking distance shall be determined by the Engineering Department based on available data from an acceptable traffic study. If a traffic study is not available, or data provided is incomplete, the Engineering Department shall estimate the length of the left turn stacking distance using the following formula:

$$\text{Peak Hour Traffic} = \frac{\text{ADT}}{10}$$

Peak hour left turns = 1/6 of peak hour traffic for 4-way intersections

Peak hour left turns = 1/4 of peak hour traffic for T-intersections

$[1.5 \times \text{peak hour left turns} \times 20'] + 20' = \text{driveway to intersection spacing} \times 30$

The Engineering Department may make adjustments in the factors used in this formula for a typical situation. Examples of such situations include the intersection of low volume roads with very high volume roads, or where adjacent land uses like the Copper Mountain or Keystone Resort areas cause traffic patterns to be skewed. If an applicant disagrees with the left turn stacking distance determined by the Engineering Department, they may propose a different distance if substantiated by a traffic study which is acceptable to the Engineering Department.

B. **Spacing of Driveways:** Driveway openings shall be separated by at least 30 feet, as measured from curve

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

return to curve return, or else shall be combined. More spacing may be required for traffic safety and proper traffic operation.

- C. **Shared Driveways:** Developers or property owners proposing the use of shared driveways shall record an easement defining the location of the driveway and either a covenant, deed restriction or plat note requiring construction of the driveway at that location. When additions or modifications requiring a Grading permit are proposed on structures for which the access crosses one (1) or more adjacent properties, an easement or other agreement acceptable to the County Engineer that provides access, shall be provided prior to the issuance of any permits.
- D. **Driveway Widths:** The dimensions of driveway widths, openings and centerline curve radii, turnout spacing for driveways, and driveway turnarounds for emergency equipment shall be as shown in Table 5-6. In addition to the requirements in Table 5-6, the Road & Bridge Department may require an increased width in the public right-of-way at their discretion, as a part of the right-of-way permit.
- E. **Driveway Grades:** Driveways for single-family residences shall have a maximum grade of eight percent (8%) for the first 25-feet from the connection to the County Road, and shall not exceed ten percent (10%) after that. Minor deviations from the maximum grades of driveways for single-family residences established in this standard (up to 12% for distances of less than 10-feet) may be approved if the County Engineer determines that no detriment to public health, safety, and welfare will result and no reasonable solution exists. In determining the reasonableness of a proposed deviation, the cost shall not be a factor. Driveways for multi-family, industrial, and commercial developments shall not exceed six percent (6%). All driveways shall maintain a grade equal to or less than the crown slope of the road from the point where the driveway meets the road to where the driveway crosses the ditch line. This transition is needed to eliminate plows catching their blades on driveways with abrupt grade changes in the vicinity of the roadway.
- F. **Vehicle Turnarounds:** All driveways exiting onto collector roads or roadways with average daily counts greater than 1,000 vehicles per day shall be designed with a vehicle turnaround to avoid vehicles having to back onto the roadway when exiting. Single-family residence driveways in excess of 400 feet in length shall provide an adequate turnaround for emergency equipment within 150 feet of the dwelling unit. Driveways that access single family residences off of the County recreational pathway system shall utilize turnarounds to the greatest extent practicable to avoid vehicles having to back onto the rec. path. Driveways serving multi-family, industrial, or commercial development shall provide a turnaround as specified in Figure 5-6 if the driveways dead-end.
- G. **Surfacing of Driveways:** Driveways serving single-family residences may be either graveled or paved. Where roads are paved, shared driveways serving duplexes must be paved.
 - 1. Where a driveway is to be graveled, the surface shall be constructed in accordance with Section 5203.08 and shall consist of a minimum four (4) inch depth of compacted aggregate base course. Alternative all-weather surfaces (e.g. recycled asphalt) may be approved with specific installation standards as deemed appropriate by the County Engineer.
 - 2. Where a driveway is to be paved, the surface shall be constructed in accordance with Section 5203.09 and shall consist of a minimum four (4) inch depth of compacted aggregate base course and two (2) inch mat of Hot Mix Asphalt (HMA), which can be placed in one lift.
 - 3. Driveways serving multi-family residences or commercial uses must be designed and paved in accordance with Section 5103.03.C, and 5203.09.
- H. **Provision for Drainage:** Driveway design shall make adequate provision for drainage and prevention of erosion.
 - 1. Drainage from driveways shall be diverted to roadside ditches or other appropriate drainage way(s). Drainage from driveways shall not flow onto roads.
 - 2. When necessary to handle roadside drainage, driveways shall use culverts, drainage pans or other devices suitable for the conveyance of roadside drainage. Final approval for the types of drainage items used and the locations of such items shall be at the discretion of the County Engineer or his delegate.
 - 3. Culverts shall be corrugated metal pipes, or other material types approved by the Road & Bridge Department. In addition, culvert design and installation shall be in compliance with the following:
 - a. Culverts shall have either flared end sections or shall have end treatments per Figure 5-9 of these standards.
 - b. There shall be a minimum of four (4) inches of road-base cover over culverts serving driveways.
 - c. Culverts lengths greater than 30 feet are not allowed.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

- d. Culverts installed for driveways shall be sized and installed subject to the provisions of the required right-of-way access permit issued for the installation, but in all cases the minimum diameter for these culverts shall be 15-inches.
- 4. Drainage pans shall be designed per Figure 5-11. Concrete for drainage pans shall be Class D as specified in the latest edition of the Colorado Department of Transportation Standard Specifications for Road and Bridge Construction.
- 5. Property owners shall be responsible for keeping their culverts clean and ice-free. The Road & Bridge Department may require owners to heat tape their culvert to ensure flow during the winter months to minimize the potential of ice forming on roadways (see Section 5507.02).
- I. **Minimum Sight Distance:** Driveways shall be designed and located to provide a minimum sight distance clear of all obstructions, natural or man-made, for at least 200 feet in either direction on local access roads and 400 feet on collector roads.
- J. **Signage at Junction with Roadway:** Stop signs shall be installed at the junction of a driveway with a roadway for all driveways serving ten (10) or more residential units, commercial shopping areas, or when required by the County Engineer for the protection of public safety.
- K. **Number of Driveway Accesses:** Only one (1) access point per single-family or duplex lot onto the County road system is allowed unless a minimum separation of 250 feet can be provided. Otherwise, looped driveways are not allowed. Where a lot has two (2) different roads to provide driveway access, access or accesses shall be drawn from a single roadway and always onto the road with the lowest functional classification. Where a property's access is proposed on a state highway, an approved CDOT access permit and associated notice to proceed must be provided prior to issuance of a grading and excavation permit for the project.
- L. **Snow Storage:** Snow storage for driveways shall be provided on the owner's property. Use of the right-of-way for snow storage by private individuals or companies is prohibited (C.R.S. 43-5-303 et seq.). Snow storage is not allowed in wetland areas.
- M. **Connection to Roads:** The portion of driveway through the right-of-way connecting the property with the physical roadway shall be the shortest perpendicular distance possible. The Road & Bridge or Engineering Department may approve minor deviations from this standard where this condition would cause excessive earth disturbance and where approval of such deviation would not pose a hazard to public health, safety, or welfare.
- N. **Retaining Walls:** If earth disturbance results in cut or fill slopes steeper than 2.0 feet horizontal to 1.0 feet vertical (2:1), a retaining structure or other engineered system shall be required. If the proposed retaining system is less than 4.0 feet in height, a detail of the proposed retaining system must be provided to the County Engineer for his approval, prior to installation. If the retaining system is over 4.0 feet in height, the retaining system must be designed by a Colorado Licensed Professional Engineer and must be submitted to the County Engineer for his approval prior to installation. In addition, prior to any occupancy permits being authorized by the County Engineer, a certification from the design engineer must be submitted to the County Engineer, stating that construction of the retaining system was in conformance with the approved design and these standards.
- O. **Upgrading of Driveways:** A driveway must be upgraded to meet current County standards any time that an owner proposes improvements that require modifications to a driveway or changes to a use on a property including but not limited to garage additions (detached or attached), accessory apartments, voluntary changes to access configurations, substantial improvements to structures or properties as defined by this Code, or any time that a non-conforming situation is deemed to present a hazard to the public health, safety or welfare.

5107.04: Standards for Parking Areas

- A. **Parking Standards:** See Section 3700 et seq. of this Code for standard parking requirements for development.
- B. **Parking Area Grades:** Parking areas shall have a maximum grade of four percent (4%) and a minimum grade of one-half percent (0.5%) to facilitate drainage.
- C. **Surfacing of Parking Areas:** Paving is not required for parking areas and driveways serving single-family units. Paving is not required for parking areas and driveways for duplexes where the road providing access is not paved. Where an access road to a duplex lot is paved, parking areas and drives for the duplex must be paved. Parking areas and drives for all other types of development must be paved. Paved parking areas for all other development shall be designed in accordance with Section 5103.03.C and 5203.09 et seq.
- D. **Provision for Drainage in Parking Areas:** Parking area design shall make adequate provision for drainage and prevention of erosion. Drainage from parking areas shall flow to roadside ditches or other approved

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE

CHAPTER 5: Road & Bridge Standards

drainage ways. Drainage from parking areas shall not flow onto roadways. Collection points for runoff across parking areas shall be provided to minimize sheet flow.

- E. **Placement of Parking Areas on Fill:** If a parking area is to be placed on fill, the fill used shall be a suitable material as specified by a licensed geotechnical engineer. The fill shall be compacted to at least 95% of the maximum dry density at +/- two percent (2%) of optimum moisture content as determined by AASHTO T-180 with slopes at no more than three to one (3:1) and protected by rip-rap to prevent erosion from snow storage. Parking areas on fill may be designed using retaining walls as an alternative in accordance with the County's Zoning Regulations and approval of the County Engineer.
- F. **Snow Storage:** Snow storage for parking areas shall be provided on the associated private property as required by Section 3700 et seq. of this Code. Use of the right-of-way for snow storage by private individuals or companies is prohibited (C.R.S. Section 43-5-301 et seq.).

5108: Landscaping

- A. Whenever roadways, driveways, parking areas, bridges, recpaths or other types of construction results in earth disturbance, revegetation and/or landscaping is required.
- B. Revegetation and/or landscaping work shall be in accordance with Chapter 3 of this Code and in accordance with the plans and specifications approved as part of any permit issuance.
- C. Earth cuts, embankment slopes and all other areas where the ground cover has been disturbed during the course of construction shall be revegetated and landscaped equal to or better than conditions existing prior to construction.
- D. Landscaping and revegetation material shall be installed in accordance with Chapter 3, Section 3600 et seq. of this Code and the approved plans and specifications, and shall be fertilized, mulched and otherwise treated to provide an established stand of vegetation by the end of the first full growing season after completion of construction.
- E. The individual responsible for construction may be required to post a performance bond guaranteeing the revegetation and/or landscaping for at least two (2) full growing seasons following installation. The County Engineer and/or the Road & Bridge Director may waive this requirement if the relief will not result in:
 - 1. Substantial detriment to public health, safety and welfare, and,
 - 2. Significant erosion potential from drainage across bare earth, and,
 - 3. Substantial impairment of this chapter and all other chapters of this Code, and,
 - 4. The granting of any special privilege or use.
- F. Areas not disturbed by construction shall be left in their present vegetative state, except that thinning of trees may be required. In no case shall landscaping in the right-of-way or on private property impede the normal maintenance operations of the Road & Bridge Department or the normal flow and operations of traffic.

5109: Recreational Pathways & Trails

This section covers two categories of trails: recreational pathways ("Recpath") and natural surface trails. The design of recpaths shall be in accordance with these standards and with the latest edition of AASHTO's *Guide for the Development of Bicycle Facilities*. For natural surface trails, the latest edition of the *Trail Construction and Maintenance Handbook*, published by the United States Forest Service ("USFS") shall be used. In the event there are discrepancies between standards, the more stringent standards shall govern.

A. General Design Elements:

The following restrictions apply to all earth disturbing activities related to the design and construction of recpaths and trails:

- 1. Wetlands: The construction of recpaths in wetland and stream setbacks shall conform to Chapter 7, Water Quality Control Regulations and Chapter 3, Zoning Regulations of this Code.
 - 2. Every attempt should be made by the landowner to maintain a significant vegetative buffer along trail rights-of-way and easements. The vegetative buffer will benefit the trail users and homeowners by providing visual screening and reducing noise disturbance.
- B. **Specific Design Elements for Shared Use Recpaths:**
The major considerations in alignment design are safety, grade, profile, path/trail width, design speed, sight

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE

CHAPTER 5: Road & Bridge Standards

distance, topography, drainage and environmental impacts. Path/trail layout should bear a logical relationship to existing paths/trails or platted easements in adjacent properties and to the principles of good engineering practice. To the extent practicable, all recpaths shall be designed such that the recpaths are centered in the right-of-way or easement.

1. **Alignment:** The horizontal and vertical alignment of all new recpaths shall be designed in accordance with the standards and guidelines set forth in the most recent edition of the AASHTO Guide for the Development of Bicycle Facilities. Where the standards in this publication cannot be achieved because of exceptional topographical or environmental conditions, a variance may be granted by the County Engineer according to the provisions in Section 5600 of this Code.
2. **Environmental Impacts:** Shared use path alignments shall be designed to fit the existing topography and vegetation. Preference will be given to those alignments which result in the least amount of environmental impact possible.
3. **Sight Distance:** Recpaths shall be designed with adequate stopping sight distances in accordance with these standards and the latest edition of the AASHTO Guide for the Development of Bicycle Facilities.
4. **Design Speed:** The minimum design speed for shared use paths shall be 20 mph for level, tangent sections. For down grades greater than four percent (4%), a design speed of 30 mph is required. The designer may consider the use of a series of short switchbacks to control speeds.
5. **Geometric Cross Sections:**
 - a. A typical section for a recpath is shown in Figure 5-5.
 - b. **Travel Lane Width:** The minimum width of a paved recpath is ten (10) feet. Where a particular route serves as a primary arterial pathway, the minimum width of a paved recpath is twelve (12) feet. A minimum two (2) foot wide graded area (shoulder) with a maximum 16% slope shall be maintained adjacent to both sides of the path. A three (3) foot wide shoulder with a maximum 16% slope may be required where poles, walls, fences, guardrails or other lateral obstructions exist or are anticipated.
 - c. **Soil Sterilant:** A soil sterilant is required to be placed between the aggregate base course surface and the HMA pavement to prevent vegetation from growing through the pavement.
 - d. **Cross Slope:** For recpaths, the high point of the slope will begin at the outside edge of the pavement and the pavement sloped toward the cut side of the recpath on a two percent (2%) slope. Where recpaths are constructed on fill sections, slope direction will be to side of least erosion potential, or as otherwise directed by the County Engineer or a designated representative thereof (see Figure 5-5).
 - e. **Pavement Structure:** The minimum structural sections outlined in Table 5-3 shall be adhered to on all shared recpaths in Summit County. These minimum structural sections are based upon a minimum subgrade “R” value of 60 or a CBR of 17. For “R” values less than 60 or a CBR less than 17, an engineered section must be designed. The proponent shall submit “R” value tests performed by an approved geotechnical engineer prior to approval of the final path design. Asphalt may be placed in multiple lifts with each lift being one and one-half (1-1/2) inches minimum or three (3) inches maximum.
 - f. **Bridges and Structures:** Bridges and all other structures shall conform to the latest edition of the CDOT Bridge Design Manual and these standards. In the event there is a discrepancy between the two, the more stringent specification or standard shall apply. Plans shall be prepared by a qualified structural engineer licensed in the State of Colorado and shall be submitted to the County Engineer for review and approval prior to construction.
 - i. Clear deck width must accommodate the full width of the travel lanes and shoulders of approach paths/trails. Where the existing path or trail is narrower than the bridge deck, a transitional approach not less than 25 feet in length shall be constructed.
 - ii. The waterway area shall accommodate a 100-year frequency storm. Where flood studies from the USACE or FEMA are available, bridges shall be designed to accommodate the “Standard Project Flood”. A minimum of one (1) foot freeboard is required. Additional freeboard shall be required when debris-laden flows are anticipated.
 - iii. Railings, fences or barriers on both sides of the bridge shall be a minimum of 1.1 meters high.
 - iv. Bridges shall be designed for pedestrian live loadings. Where maintenance and emergency vehicles may be expected to cross the bridge, the design shall include them as well.
 - v. All bridge decks shall incorporate bicycle-safe expansion joints, and shall have a non-skid surface texture.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

6. Drainage:

- a. Pavements: All path/trail surfacing shall have a minimum two percent (2%) cross slope. In addition, path/trail surfacing shall be free of depressions and excessive surface voids, which create water ponding and/or ice build-up. Such items as culverts, catch basins and drainage ditches shall accomplish positive drainage away from the path/trail surface. Final approval for the types of drainage items used and the locations of such items shall be at the sole discretion of the County Engineer.
- b. Culverts: Culverts under all recpaths shall be designed, at a minimum, to accommodate a 25-year frequency storm runoff utilizing the maximum available head. The maximum available head shall be determined by the uppermost ponding elevation chosen to prevent flood damage to upstream properties.
 - i. Culverts shall be located at each natural draw or watercourse as conditions warrant to prevent excessive accumulation of flow in roadside ditches or along the toe of slopes. Draws and watercourses shall be cleared of debris for a distance of 100 feet upstream from all culvert inlets.
 - ii. Inverts at the inlet shall be slightly elevated above the normal flow line in steep or natural draws to avoid plugging by debris. Inlets shall not be elevated in those instances where ponding or accumulation of backwater curves would be objectionable (stagnation, irrigation ditches, etc.).
 - iii. The culvert shall slope downward in the direction of natural flow and be designed to be self-cleaning whenever possible. The outlet shall be designed not to discharge on unprotected fills or unstable material or at adverse angles to streams or open channels. Headwall, riprap or other means of protection are required at inlets or outlets where erosion might occur.
 - iv. Velocities of flow in culverts shall be calculated using acceptable design charts or formulas.
 - v. Corrugated metal pipe, HDPE, or an approved equal as specified by the Road & Bridge Director or his authorized representative and/or the County Engineer shall be used. Steel pipe shall be asphalt coated where soils are corrosive or other conditions exist that may attack steel. Aluminum or other pipe materials are not permissible for recpath culverts.
 - vi. The minimum diameter for round pipe shall be 18 inches. The minimum rise for squash pipes shall be twelve (12) inches.
 - vii. The minimum cover for culvert pipe under a recpath is twelve (12) inches.
 - viii. When a battery of pipes is used, a clear spacing of ½ the pipe diameter (one (1) foot minimum, four (4) foot maximum) must be provided between pipes. Minimum and maximum cover, pipe metal gauge and strength classification shall be as specified in section on culverts (see Section 5203.06).
- c. Ditches: Where a shared use path/trail is constructed on a side hill, a minimum 1.0' v-ditch shall be placed on the uphill side to intercept the hillside drainage.
 - i. Where shared use paths are not constructed on hillsides, or when shared use paths are adjacent to existing highway facilities, channels and ditches shall be designed to avoid roadside safety hazards. The minimum flow line slope shall be three-quarters percent (0.75%). Maximum slopes shall be controlled by the maximum permissible velocities given in Table 5-5.
 - ii. Manning's equation shall be used, as follows, to estimate velocities.

$$V = \frac{1.486R^{2/3}S^{1/2}}{n}$$

where,

V = velocity of flow in channel in feet per second

n = roughness coefficient (Table 5-5)

R = hydraulic radius in feet

S = slope in feet per foot

- iii. Where the channel is comprised of a combination of the materials given in Table 5-5, the maximum permissible velocity selected should prevent undue scouring of the finer materials silting downstream.
- 7. Traffic Control Devices:** All traffic control devices including signs and pavement marking shall be in accordance with Section 5106.02 of these standards.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

8. **Inspections:** Inspections of the work shall be in accordance with Section 5203.02 of these standards. Except that inspection and approval of a natural surface trail shall be performed by a representative from the Summit County Open Space & Trails Department.

5200: ROAD, BRIDGE AND RECREATIONAL PATHWAY CONSTRUCTION SPECIFICATIONS

5201: Purpose and Intent

This section sets forth specific standards for road, bridge and recpath construction in Summit County and is intended for use by the developers, property owners, contractors and others engaging in the construction or maintenance of new roads or upgrading of existing roads, building of bridges and the construction or maintenance of recpaths.

5202: Closing of Streets, Roads and Recreational Pathways

5202:01: Notice and Operation of Road Closure

- A. Contractors may only close roads or recpaths after obtaining approval for an alternate route from the County, and they shall provide detour signs. Contractors shall furnish, erect and maintain, at their own expense, necessary barricades, suitable and sufficient flashers and construction signs. Contractors shall also provide a sufficient number of flagmen and take necessary precautions for the protection of the work and safety of the public around their construction operations.
- B. If construction-operating conditions require closure of a road or recpath, the contractor shall provide notice as follows:
1. Submit a signage plan for review and approval by the Road & Bridge Department a minimum of 48 hours prior to closing of the road or recpath. See Section 5403.04 for emergency situations.
 2. Submit a written notice to the Road & Bridge Department 48 hours prior to closing of the road or recpath.
 3. Notify the Summit County Communications Center of the exact location of the road or recpath and the date traffic will be impeded 24 hours prior to closing of the road or recpath.
 4. Notify the appropriate local papers and/or radio station to announce the upcoming road or recpath closure.

5203: Construction of Roads and Recreational Pathways

5203.01: Permits Required for Road and Recreational Pathway Construction

Whenever road or recpath construction results in earth disturbance, the individual responsible for the construction must obtain approval for a grading permit from the Engineering Department prior to commencing construction. The submittal requirements and procedure for obtaining grading permits are stated in Section 6000 et seq. of this Code.

5203.02: Construction Inspection and Testing Requirements for Road and Recreational Pathway Construction

- A. **Quality Control:** Quality control supervision of construction shall be done by a qualified geotechnical consultant at no expense to the County. The County inspector shall be permitted access to the construction site at all times to make spot checks for quality control. Any additional testing or corrective work deemed necessary shall be done within the time determined by the County Engineer at no expense to Summit County. The contractor or developer must contact the County Engineer 24 hours in advance of the required final inspection.
- B. **Sampling of Materials:** Samples for preliminary approval or production control may be submitted by the producer to the geotechnical consultant. The geotechnical consultant must use the procedure(s) established in the most recent edition of the CDOT Field Materials Manual to determine acceptance of proposed materials.
- C. **Field Density Determination:** Proposed testing shall be in conformance with current the American Society for Testing and Materials (ASTM), AASHTO, or CDOT standards, and shall be submitted as part of the design documents or proposal, and must be approved by the County Engineer prior to issuance of a notice to proceed.
- D. **Periodic Inspection During Construction:** The Engineering Department or their authorized representative shall conduct periodic inspections, as well as require independent testing and inspections, during construction to

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

assure compliance with approved grading and construction plans.

1. The Engineering Department shall establish specific checkpoints of when inspections must be conducted and approvals granted before construction is continued as part of issuing a grading permit. The check points are as follows:
 - a. Rough grading.
 - b. Subgrade preparation.
 - c. Utility installations.
 - d. Placement of road base.
 - e. Paving (if applicable).
 - f. Construction of drainage improvements (including culverts for driveways, if applicable).
 - g. Placement of signs (if applicable).
2. Independent testing shall be required for all sub-base, subgrade and paving as follows:
 - a. Standard Proctors shall be required for each material installed in the sub-base and sub-grade.
 - b. Density and moisture condition tests shall be required in accordance with the provisions of this section at intervals of one per 200-feet of roadway constructed.
 - c. Relative density of asphalt placed shall be tested in accordance with the provisions of this section at a minimum frequency of one test per 200-feet of paving installed.
 - d. The County Engineer may issue an explicit written waiver or alternative to these minimum standards at his sole discretion if it is determined that adequate or equivalent quality control and quality assurance can be achieved through alternative or reduced procedures.

E. Final Inspection:

1. Upon completion of construction and prior to County approval of the completed work, copies of the as-built plans, concrete cylinder test reports, compaction test reports, aggregate gradation, asphalt binder content, and other test data as required by the County Engineer shall be delivered to the Engineering Department. In addition a certification shall be given by the developer's engineer that construction has been completed in conformance with the approved lines, grades, specifications and standards (see Section 5007.01).
2. The Engineering Department shall conduct a final inspection to determine if the construction meets County standards and specifications. If the inspection discloses any work, in whole or in part, as unsatisfactory, the County Engineer shall give the developer's engineer the necessary instructions for correction, and the contractor shall comply with and execute such instructions. At the discretion of the County Engineer, the County may withhold the granting of further building permits or any occupancy permits for the project until all required corrective work is completed.

5203.03: Site Preparation

- A. **Utilities Protection:** The developer or contractor shall at all times take proper precautions to assure the protection of utilities, service lines or other public or private installations and shall be responsible for the repair of any damage. The developer or contractor shall notify the utilities 48 hours before excavation begins, so the utilities can locate the services.
- B. **Grubbing:** All large rocks, brush debris, structures and all other unsuitable material shall be cleared to a depth of at least twelve (12) inches below subgrade or as directed by the County Engineer and replaced with suitable material. Locating suitable disposal sites shall be the responsibility of the contractor or developer subject to County approval. Trees, except those designated to be saved, and all stumps shall be removed to a depth of at least 18 inches below the finished subgrade elevation. All trees designated to be saved shall be protected during clearing and subsequent construction operations. Suitable material removed from the excavation may be used in the formation of embankments, backfilling and for other such purposes. Unsuitable material must be disposed of at a location approved by the Engineering Department, as a part of the excavation or earthwork contract line item.

5203.04: Structural Embankment Construction

Embankment construction consists of constructing roadway and recpath embankments including preparation of the areas upon which they are to be placed, constructing dikes within or outside the right-of-way or recpath easement, placing and compacting of approved material within roadway areas where unsuitable material has been removed, and

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

placing and compacting of embankment material in holes, pits and other depressions within the roadway area. Only approved materials shall be used in the construction of embankments and backfills.

- A. **Benching:** When an embankment is to be placed and compacted on slopes steeper than four to one (4:1), the roadway and recpaths shall be continuously benched over those areas. A bench is required at vertical intervals of ten feet maximum or as required by the County Engineer. Benching shall be well keyed and, where practical, a minimum of eight feet wide. Each horizontal cut shall begin at the intersection of the original ground, and the vertical sides of the previous cuts. The material shall then be re-compacted along with the new embankment material as a part of the excavation or earthwork line item.
- B. **Compaction:** Minimum compaction shall be at least 90% of the maximum dry density at +/- two percent (2%) of optimum moisture content as determined by AASHTO T-180.
- C. **Riprap:** Where embankments encroach on stream channels or lakes, calculations of the flows or wave action shall be made and submitted to the County. Based on these calculations, and standard engineering practices, the appropriate size riprap shall be placed along the toe of the slope to protect the embankments against erosion from the anticipated hydro-dynamic forces.
- D. **Prohibited Materials:** Organic material, wet or frozen material, snow, ice or other unsuitable materials shall not be used for any structural embankment construction.

5203.05: Trench Excavation

Trenches shall be excavated so that pipes can be laid straight at uniform grade, without dips or humps, between the terminal elevations shown on the drawings. Wherever a trench passes through a fill or embankment, the fill or embankment material shall be placed and compacted to an elevation twelve (12) inches above the top of the pipe before the trench is excavated.

- A. **Trench Widths:** Trenches shall be excavated to a width necessary to provide adequate working space and side clearances for proper pipe installation, jointing and embedding. Minimum trench widths at or below an elevation six (6) inches above the top of installed pipe shall not be less than the pipe's outer diameter plus 24 inches.
- B. **Excavation Below Pipe Subgrade:** Except where otherwise required, pipe trenches shall be excavated below the underside of the pipe, as shown on Figure 5-8, to provide for the installation of granular pipe bedding foundation material.
- C. **Bedding Material:** Bedding shall be installed according to applicable CDOT M&S standards for all RCP, HDPE, corrugated metal pipe (except where arch encasement is required), and cast iron pipelines, as shown on Figure 5-8.
- D. **Placement and Compaction:** Granular bedding material shall be spread and the surface graded to provide a uniform and continuous support beneath the pipe at all points between bell holes or pipe joints. It is permissible to slightly disturb finished subgrade surface by withdrawal of pipe slings or other lifting tackle.
 - 1. After each pipe has been aligned, placed in final position on the bedding material and shoved home, sufficient pipe bedding material shall be deposited and compacted under and around each side of the pipe and back of the bell or end to hold the pipe in proper position and alignment during subsequent pipe jointing and embedding operations. Bedding material shall be deposited and compacted uniformly and simultaneously on each side of the pipe to prevent lateral displacement.
 - 2. Bedding shall be compacted to the top of the pipe in all areas where compacted backfill is specified.
 - 3. Whenever crushed rock is used as bedding for 36-inch and larger pipe, the portion above the bottom of the pipe shall be vibrated with a mechanical vibratory compactor during placement to ensure that all spaces beneath the pipe are filled.
- E. **Backfill Over Concrete:** All backfill over concrete shall conform to the following requirements:
 - 1. Initial Backfill: To aid curing, no more than eight (8) inches of loose backfill shall be placed over concrete after the concrete has reached its initial set.
 - 2. Final Backfill: Additional backfill shall not be placed over arch encasements or blocking until the concrete has been in place at least three (3) calendar days.
- F. **Compacted Backfill:** Compacted backfill shall consist of suitable job excavated-material, finely graded and free from debris, organic material, cinders, snow, ice or other unsuitable materials, and stones larger than three

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

(3) inches in greatest dimension. Masses of moist, stiff clay shall not be used. Job-excavated materials shall be placed in uniform layers not exceeding eight (8) inches in un-compacted thickness. The method of compaction and the equipment used shall be appropriate for the material to be compacted, and shall not transmit damaging shocks to the pipe. Job excavated material shall be compacted to at least 90% of the maximum dry density at +/- two percent (2%) of optimum moisture content as determined by AASHTO T-180, except for the final two (2) feet which will be compacted to at least 95% of the maximum dry density at +/- two percent (2%) of optimum moisture content as determined by AASHTO T-180. Compacted backfill is required for the full depth of the trench above bedding in the following locations:

1. Beneath driveways, parking areas, roads, recpaths or other construction or structures; or,
 2. In driveway and parking area shoulders; or,
 3. Beneath fills or embankments.
- G. **Flow-Fill:** There may be circumstances, for example in locations where proper compaction is difficult or impractical to achieve, or where compaction is critical to the performance of surface improvements, when the County Engineer or the Road & Bridge Department require the use of flow-fill in lieu of compacted backfill. In such cases, the use of flow-fill shall conform to the material specifications, and shall be approved by any utilities that may be affected by the use of such material prior to placement.

5203.06: Culverts

This section covers corrugated metal pipe or approved equal to be used for minimum 18-inch storm drains beneath driveways, accesses and roads to convey storm drainage. Culvert sizing shall be in accordance with Section 5103.03.D of the Road Standards. Corrugated metal pipe or approved equal shall be furnished and installed with all jointing materials, accessories and appurtenances as indicated on the drawings and as specified.

- A. **Materials:** Materials used for storm drains shall conform to the applicable AASHTO provisions of the "Standard Specifications for Highway Materials."
1. Corrugated metal pipe shall be AASHTO M36-78 and galvanized with two and two-thirds (2-2/3) inch x one-half (1/2) inch corrugations. The corrugations may be annular or spiral with annular ends as shown in Figure 5-9.
 2. Coupling Bands: All field joints in corrugated metal pipe will be made with coupling bands, fabricated from the same material as the pipe. Coupling bands for field joints in corrugated metal pipe for all culverts shall be the pipe manufacturer's standard coupling band type.
 3. Flared metal end sections shall be provided on all culverts unless otherwise specified by the County Engineer. The end sections shall be fabricated from 16 gauge-galvanized sheet metal for pipe smaller than 24-inches in diameter, and 12 gauge galvanized sheet metal for pipe 24-inches in diameter or larger. The end sections shall be provided with a rolled reinforced edge and a galvanized top finish plate.
- B. **Handling:** Pipe, couplings and accessories will be handled in a manner that will ensure installation in sound, undamaged condition. Equipment, tools and methods used in unloading, reloading, hauling and laying pipe will be such that the pipe is not damaged.
- C. **Cleaning:** The interior of the pipe and any couplings shall be thoroughly cleaned of all foreign matter before being installed. Before jointing, all joint contact surfaces shall be wire-brushed if necessary, wiped clean and kept clean until jointing is completed.
- D. **Installation:**
1. Corrugated metal pipe shall be laid true to the grade required by the drawings, and shall be installed in accordance with the following requirements:
 - a. Pipe: The pipe shall be installed in accordance with the details indicated on Figure 5-8 and the applicable standards in the excavation section. The pipe shall be protected from lateral displacement by means of a pipe bedding material as specified for trench backfill. The minimum cover for culvert pipe in a roadway is twelve (12) inches.
 - b. Couplings: Sections of the corrugated metal pipe shall be joined together using metal coupling bands, centered on the joint, and with the pipe sections as close together as possible. Each coupling band shall be bolted in place and tightened sufficiently to ensure a tight joint and to form a continuous conduit capable of resisting all stresses. Pipe shall not be laid in water or under unsuitable weather or trench conditions.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE

CHAPTER 5: Road & Bridge Standards

- c. End Sections: The end sections shall be attached to the culvert by threaded rod and connecting lug.
 - d. RipRap: Culverts shall have a riprap bed of ten (10) feet in length by ten (10) feet in width or the width of the ditch, whichever is less, at the inlet and outlet for erosion control. The riprap shall consist of hard, dense, sound, rough fractured rock as nearly cubic as practical. Pit run or dredge rock can be substituted. Slab type and flaking rocks shall not be used. Riprap shall be specified by the engineer of record on the project, and shall be sized according to the 5-year flows anticipated in the channel.
2. Use of Culverts at Access Point to Roads: Driveways, road or recpath connections to a County road or recpath shall not be constructed in such a way as to impede the normal flow of drainage in roadside ditches, culverts, under drains, bridges or other drainage works, or to cause such drainage to flow onto or across the driving surface of a County road. In the event that such an impediment results in damage to a County road, the Road & Bridge Director will remove the impediment and bill the property owner for the costs of repairs to the road, including labor, equipment and material. In certain instances, a culvert may not be required by virtue of the topography. In that event, a written waiver must be obtained from the Road & Bridge Department. Such a waiver does not constitute a waiver of the permit fee, inspection of the access or any other requirement of the access.

5203.07: Subgrade

The bottom of the excavation or top of the fill is considered the subgrade, and shall conform to the lines, grades, and cross sections shown on the plans.

- A. Soft, spongy or frozen subgrade shall be removed as directed and replaced with suitable granular material placed and compacted as specified in Section 5203.04.
- B. Before subbase construction begins, soils in the subgrade shall be compacted to at least 90% of the maximum dry density as determined by AASHTO Method T-180 and the moisture content must not deviate by more than three percent (3%) of the theoretical optimum.

5203.08: Gravel Roads

Gravel roads shall consist of a compacted subbase to 50% of the design thickness and the remainder compacted base course.

- A. **Gravel Specifications:** Gravel used in road construction shall be crushed to a required size and a filler of sand or other finely divided mineral matter must be used. The portion of material retained on a No. 4 sieve is considered filler. At least 50% by weight of the coarse aggregate particles shall be particles having at least two fractured faces. The gravel shall be screened if necessary to meet this requirement or to eliminate an excess of filler. The composite base course material and subbase course shall be free from organic matter, snow, ice or other unsuitable materials, and meet the grading requirements in Table 5-7.
- B. **Compaction of Subbase or Base Course (Gravel Roads):** The subbase or base course shall be placed and spread in a uniform layer and without segregation of size to a depth not exceeding eight (8) inches of un-compacted material. The material will be compacted to at least 95% of the maximum dry density at +/- two percent (2%) of optimum moisture content as determined by AASHTO T-180.
- C. **Manholes:** On gravel roads where manholes or water valve boxes are located in the roadway, they must have a minimum of five (5) inches of cover at finished grade.
- D. **Dust Abatement:** The County may require an appropriate dust abatement material be applied to gravel roads in residential areas or as deemed necessary by the County Engineer and the Road & Bridge Director or his authorized representative, or as required by State or local air quality regulations.

5203.09: Hot Mix Asphalt Pavements

Hot Mix Asphalt (“HMA”) pavements shall be designed, installed, constructed, maintained and repaired in accordance with these standards and with the latest edition of the CDOT Pavement Design Manual or the AASHTO Guide for the Design of Pavement Structures. In the event of discrepancies between these standards and the referenced publications, the more stringent shall take precedence.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

A. Aggregate Base Course:

1. Aggregate Base Course Specifications:
 - a. Aggregate for bases shall be crushed stone, crushed slag, crushed gravel, natural gravel, or crushed reclaimed concrete or asphalt material which conforms to the quality requirements of AASHTO M 147, except that the requirements for the ratio of minus No. 200 sieve fraction to the minus No. 40 sieve fraction, stated in 2.2.2 of AASHTO M 147, shall not apply.
 - b. Aggregate for bases shall be free from organic and frozen matter, lumps or balls of clay.
 - c. Aggregate for bases shall meet the specifications shown in Table 5-8 for Class 5 or Class 6 Aggregate Base Course, and shall have a liquid limit of no greater than 30 and a plasticity index of no greater than six (6) when the aggregate is tested in accordance with AASHTO T-89 and T-90, respectively.
 - d. Aggregates for bases, when tested in accordance with AASHTO T-96, shall have no more than 50% wear.
 - e. The use of mine waste or other potentially environmentally hazardous materials as aggregate base course material without the prior review and approval of the County Engineer is prohibited. The developer or contractor must identify the source of aggregate base course material to the County Engineer prior to incorporation of such material into the project (or prior to the issuance of a grading permit). The County may require analysis and testing of material proposed to be utilized as aggregate base course material for heavy metals and other environmentally damaging substances prior to incorporation of the material into the project (or prior to the issuance of a grading permit). If inspections disclose the unapproved use of mine wastes or other potentially environmentally damaging substances as aggregate base course, the County, at the discretion of the County Engineer, may withhold the granting of any further permits or approvals to the developer or contractor for the project until at such time as the developer or contractor has completed the necessary corrective work.
2. Compaction of Aggregate Base Course (Asphalt Roads): Placement of aggregate base course material shall conform to the lines, grades, cross-sections, the thickness shown on the approved plans, and when placed and compacted, it shall result in a firm, dense, unyielding foundation.
 - a. Aggregate base course material shall not be placed upon a soft, spongy or frozen subgrade.
 - b. Aggregate base course material shall be deposited and spread without particle segregation in loose layers not to exceed six (6) inches in depth when compacted. If the required compacted depth of the aggregate base course exceeds six (6) inches, it shall be constructed in two (2) or more layers of approximately equal thickness.
 - c. The material shall be compacted to at least 95% of the maximum theoretical dry density at +/- two percent (2%) of optimum moisture content as determined by AASHTO T-180.
 - d. The surface of each layer shall be maintained during the compaction operations so that a uniform texture is produced and the aggregates are firmly keyed. Water shall be uniformly applied during compaction, in the quantity necessary for proper compaction.

B. Hot Mix Asphalt Pavement: This work consists of one (1) or more courses of Hot Mix Asphalt laid upon a prepared base in accordance with these specifications, and in conformity to the finished lines, grades and thicknesses shown on the approved plans.

1. HMA pavement shall be composed of a mixture of aggregate, filler or additives if required and approved, bituminous material and reclaimed material if permitted and used.
2. HMA pavements shall be designed in accordance with the latest editions of the CDOT Pavement Design Manual and Standard Specifications for Road and Bridge Construction.
3. HMA mix designs shall be prepared by a Colorado licensed Professional Engineer with expertise in the design of HMA pavements.
4. The HMA mix design shall include a job mix formula for each mixture proposed to be used on the project. The job mix formula for each mixture shall establish a single percentage of aggregate passing each required sieve size, a single percentage of bituminous material to be added to the aggregate and a single temperature for the mixture at the discharge point of the plant. After the job mix formula is established, all mixtures furnished for the project shall conform to the following ranges of tolerances:

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

Bitumen	± 0.3%
Asphalt Recycling Agent	± 0.2%
Temperature of mixture when emptied from mixer	± 20° F
Passing 3/8 inch sieve	± 6%
Passing No. 4 and No. 8 sieves	± 5%
Passing No. 30 sieve	± 4%
Passing No. 200 sieve	± 2%

5. The County Engineer or his designated representative must approve any proposed HMA mix designs prior to placement of HMA pavement.
6. Materials to be used in Hot Mix Asphalt:
 - a. Aggregate for HMA Pavements: The aggregates for HMA pavements shall be of uniform quality, composed of clean, hard, durable particles of crushed stone, crushed gravel, natural gravel, or crushed slag. Aggregates for HMA pavements shall comply with the gradations specified in the most recent edition of the CDOT Standard Specifications for Road & Bridge Construction, and shall not contain clay balls, vegetable matter, snow, ice or other unsuitable materials.
 - i. Of the particles retained on the No. 4 sieve, at least 80% by weight shall have at least two (2) fractured faces.
 - ii. The crushed gravel, when tested in accordance with AASHTO Standard Test Designation T-96, shall have no more than 45% wear and shall show no detrimental amount of stripping when tested.
 - iii. Determination of the effect of water on the cohesion (stripping resistance) of HMA composed of the proposed mineral aggregates shall be made in conformance with AASHTO Standard Test Designation T-165-77 with a minimum dry strength of 200 psi with a minimum retained strength of 75% of the dry strength.
 - b. Asphalt Cement: Bituminous materials shall conform to the specifications in the most recent edition of the CDOT Standard Specifications for Road & Bridge Construction.
7. Sampling and Testing: All sampling and testing of materials incorporated into the HMA mixture, shall be performed in accordance with the latest AASHTO Materials Testing and Sampling Manual, and the latest editions of the Colorado Department of Transportation, Field Materials Manual and Lab Manual of Test Procedures. The County Engineer shall be supplied with Certificates of Compliance or test reports, for all materials incorporated into the HMA mixture, by a Colorado Licensed Professional Engineer with expertise in the sampling and testing of HMA materials, before any asphalt is placed. Samples shall be obtained from the back of the paver for oil content and gradation testing once per day for paving operations, and density tests shall be performed at a frequency of one per 200 linear feet of asphalt placed, both in accordance with Section 5203.02 of this standard.
8. Construction of Hot Mix Asphalt Pavements: The construction of Hot Mix Asphalt pavements shall be in accordance with these standards and with the latest edition of The Colorado Department of Transportation Standard Specifications for Road and Bridge Construction. In the event of discrepancies between these standards and the Colorado Department of Transportation Standard Specifications for Road and Bridge Construction, the more stringent shall take precedence.
 - a. General Conditions: HMA mix shall be placed only on properly constructed and accepted surfaces that are free from water, snow and ice.
 - i. The HMA mixture shall be placed within the air temperature limitations as shown in Table 5-10 and only when weather conditions otherwise permit the pavement to be properly placed and finished.
 - ii. The top lift of HMA pavement shall not be placed between October 1st and April 1st unless otherwise approved by the County Engineer or the Road & Bridge Director. This approval will not waive the above table or any other specifications.
 - iii. When it is in the public's best interest and approved by the County Engineer or the Road & Bridge Director, the following shall apply:
 - (a) Minimum temperature requirements may be waived for prime coats and layers of HMA below

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

the top layer of the completed pavement. However, pavement operations will be suspended when density requirements are not met.

- (b) The Road & Bridge Director and/or County Engineer shall have the authority to delay paving if it is their opinion the road subgrade may continue to have structural problems such as settling. The delay will be through one (1) winter and spring season. The road will again be inspected in the early summer. At that time, the following will occur:
 - (i.) Repair of any subgrade problems that may have occurred.
 - (ii.) A decision to allow paving to occur or the delay of possible paving until the next year.
 - b. Financial Guarantee: Whenever paving is performed in a public right-of-way in unincorporated Summit County, a financial guarantee for the paving may be required until such time that paving occurs. After paving, any financial guarantee shall remain in place for one full year from the date of final acceptance/approval by the County to warranty the structural integrity of the road.
 - c. Pavement Thickness: When HMA pavement thicknesses in excess of three (3) inches are called for, they shall be laid in separate courses of not less than one and one-half (1-1/2) inches nor more than three (3) inches. The thicknesses called for are finished thicknesses after compaction.
9. Hauling Equipment: Trucks used for hauling HMA mixtures shall have tight, clean smooth metal beds thinly coated with a minimum amount of paraffin oil, lime solution or other approved release agent. Petroleum distillates such as kerosene or fuel oil will not be permitted. Each truck shall have a cover or canvas or other suitable material to protect the mixture from the weather.
10. HMA Pavers: Self-propelled HMA pavers shall be provided and equipped with an activated screed or strike-off assembly, heated if necessary, capable of spreading and finishing the HMA material in lane widths applicable to the typical section and thickness shown on the approved plans and the figures contained in these standards. Pavers used for shoulder and recreational trail construction shall be capable of spreading and finishing courses of HMA plant mix material in the width and thickness shown on the approved plans.
- a. The paver's receiving hopper shall have sufficient capacity for a uniform spreading operation and shall have an automatic distribution system that will place the mixture uniformly in front of the screed.
 - b. The screed or strike-off assembly shall produce the specified finish surface without tearing, shoving or grouping the mixture.
 - c. Pavers shall be equipped with automatic screed controls with sensors capable of sensing grade from an outside reference line and maintaining the screed at the specified longitudinal grade and transverse slope. The sensor shall be constructed to operate from either or both sides of the paver and shall be capable of working with the following devices:
 - i. Ski-type device at least 30 feet in length.
 - ii. Short ski or short shoe.
 - iii. At least 5000 feet of control line and stakes.
 - d. The controls shall be capable of maintaining the screed at the specified transverse slope within +/- one-tenth percent (0.1%).
 - e. Manual operation will only be permitted for constructing irregular shapes and minor areas. In addition, if the automatic controls fail or malfunction, the equipment may be operated manually for the remainders of the normal working day provided specified results are maintained.
 - f. If the contractor/developer fails to obtain and maintain the specified surface tolerances, the paving operation shall be suspended until satisfactory corrections, repairs or equipment replacements are made.
11. Surface Conditioning:
- a. Irregularities in the existing pavement or base shall be brought to uniform grade and cross-section.
 - b. Prior to placing tack coat and beginning the overlay work, all surfaces to be tack coated shall be swept to remove accumulations of loose gravel and debris. Tack coat will be required between all pavement courses. Tack coat or other types of bituminous material as specified, shall be placed on the contact surfaces of curbs, gutters, headers, manholes, etc., prior to the placement of HMA against them.
12. Spreading and Finishing:
- a. The minimum temperature of the mixture when discharged from the mixer and when delivered for use shall be as shown in Table 5-9:
 - b. The HMA mixture shall be transported and placed on the roadway without segregation. All segregated areas behind the paver shall be removed immediately upon discovery. The segregated material shall be

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

replaced with specification material before the initial rolling has taken place. Immediately after the course is screened and before roller compaction is started, the surface shall be checked, any inequalities adjusted, all fat sandy accumulation from the screen removed by a rake or hoe and all fat spots removed and replaced with satisfactory material. Irregularities in alignment and grade along the outside edge shall also be corrected by the addition or removal of mixture before the edge is rolled. Special attention shall be given to the straightening of each course immediately following the initial rolling.

13. Compaction:

- a. The HMA pavement shall be compacted by rolling. Both steel wheel and pneumatic tire rollers will be required. The number, weight and type of rollers furnished shall be sufficient to obtain the required density while the mixture is in a workable condition. Compaction shall begin immediately after the mixture is placed and be continuous until the required density is obtained. When the surface temperature falls below 185° F, no further compaction effort will be permitted unless approved, or otherwise specified and approved by the Engineering Department in the construction specifications provided by the project engineer.
- b. Final compaction shall result in a course that is smooth and true to the established crown and grade. It shall have the average thickness specified and shall at no point vary more than one-quarter (¼) inch from the thickness specified. All roller marks shall be removed with the finish rolling. Use of vibratory rollers with the vibrator on will not be permitted on final rolling.
- c. The surface of the finished pavement shall be free from depression exceeding three-sixteenths (3/16) inch in ten (10) feet as measured by a ten (10) foot straight edge measured in any direction or an automobile mounted recording profilometer.
- d. The asphalt concrete pavement shall be compacted to a density of 92% to 96% of the maximum theoretical density, as determined according to CDOT Procedure #51. Field density determinations will be made in accordance with CDOT Procedures #44 and #81.
- e. Along forms, headers, curbs, walls and all other places not accessible to the rollers, the mixture shall be thoroughly compacted with mechanical tampers.
- f. Any mixture that becomes loose and broken, mixed with dirt, or in any way defective, shall be removed and replaced with fresh hot mixture, which shall be compacted to conform to the surrounding area.

14. Joints:

- a. Longitudinal and transverse joints shall be well bonded and sealed. Joints shall be painted with cutback asphaltic cement where necessary to obtain this result. In making the joint along any adjoining edges such as curb, gutter or an adjoining pavement and after the hot mixture has been placed by the finishing machine, just enough of the hot material shall be carried back to fill any space left open. The joint shall be properly set up with the back of a rake at proper height and level to receive the maximum compression under rolling.
- b. Joints between old and new pavements or between successive days work shall result in a thorough and continuous bond between the old and new surfaces. The edge of the previously laid course shall be cut back to its full depth to expose a fresh surface, after which the hot mixture shall be placed against it and raked to a proper depth and grade. Hot smothers or tampers shall be used to heat the previously laid pavement (without burning it) to ensure a proper bond.

15. Drainage Pans: Drainage pans may be used where approved by the County Engineer. The drainage pan design shall conform to the design as shown in Figure 5-11, or an alternate design if approved by the County Engineer during site plan review.

16. Speed Bumps: Proposals for installing speed bumps shall be considered according to the Speed Bump Approval Process on file with the Engineering Department.

5300: ACCESS PERMIT REQUIREMENTS

5301: Purpose and Intent

Access permits must be obtained whenever a developer, contractor, property owner or other individual proposes to connect a driveway to an existing public or private roadway or recpath in unincorporated Summit County. The reason for requiring access permits is to ensure that the design of the connection meets the specifications in these regulations and allows for proper drainage. Access permits are also intended to assure adequate reconstruction

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE

CHAPTER 5: Road & Bridge Standards

and/or repair of any damage caused to the County road right-of-way, or recpath easement, roadway or recpath during construction of the connection. Access permits shall be considered a part of the Grading and Excavation permit for a project and shall be issued concurrently with, or prior to, building permits where applicable.

5302: Procedures/Requirements for Issuance of Access Permits

The following procedures must be followed and requirements must be met in the review of applications for access permits.

5302.01: Submittal Requirements for Access Permits

The following information must be submitted with any application for an access permit, unless specific items are waived by the Engineering Department as unnecessary.

- A. Fee as required by resolution of the BOCC.
- B. Completed permit form.
- C. Site plan showing the following information:
 - 1. Well location, if any.
 - 2. Existing structures, if any.
 - 3. Proposed structures including any garages.
 - 4. Location of property lines.
 - 5. Location of required setbacks and their dimensions.
 - 6. Location of proposed driveways and their grades.
 - 7. Location of any parking area proposed.
 - 8. Access point to County roadway.
 - 9. Location of drainage culvert, if applicable.
 - 10. Evidence of legal access.

5302.02: Action on Access Permits

Applications for access permits shall be considered a part of a building permit application for any new construction and a part of the grading permit for any work not associated with a building permit, and shall be reviewed by the Engineering Department. Approval shall be granted only if the proposed driveway, roadway or recpath connection meets the specifications in these regulations and the required fee has been paid. Approval of an access permit may be accompanied by any conditions deemed reasonable by the Engineering Department to ensure protection of health, safety and welfare and compliance with these regulations. Applications for access permits must be submitted at least three (3) calendar days prior to planned commencement of construction, and construction cannot commence without permit approval. Whenever an access permit is needed for a development project, building permits shall not be issued for the project until approval is granted for the needed access permit.

5302.03: Construction Specifications for Access Work

All work undertaken to connect driveways to existing County roadways shall conform to the Road & Bridge Design and Construction Standards contained in these regulations.

5302.04: Construction Schedule for Access Work

As part of its approval of any access permit, the Engineering Department shall also approve a construction schedule. The approved schedule shall not be changed after the permit is issued without the written consent of the Engineering Department.

5302.05: Supervision of Access Work

The permittee shall at all times conduct work within County right-of-way or recpath easement so as to avoid

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

obstruction and hazard to the traveling public. Materials necessary for construction of access points to the County roadway shall not be stored in the County right-of-way or recpath easement at any time. The roadway and roadside area where access work has been performed shall be thoroughly cleared of all debris and extraneous material and shall be restored to a condition equal to or better than the original when construction is concluded. Where a driveway is to be paved, an inspection by the County Engineer or his designee shall be required after completion of base course compaction and prior to placement of HMA.

5302.06: Inspection and Testing of Access Work

- A. Inspections of the work shall be in accordance with Sections 5203.02.C and D.
- B. It is the responsibility of the permittee to contact the Engineering Department 48 hours in advance of required inspections.
- C. A final inspection at the conclusion of construction is required. In making this inspection, the Engineering Department shall check for compliance with these regulations and approved plans, and also for adequate cleanup of roadway or recpath surfaces and the right-of-way, or recpath easement. Certificates of occupancy (or Certificates of completion, where applicable) shall not be issued by the Building Department until access work is determined to be satisfactory by the Engineering Department.
- D. Any work or material which does not conform to these regulations, any pavement failures or broken asphalt, damaged signs or fencing, and remaining debris either in the roadway or adjacent property, or improper drainage shall be brought to the attention of the permittee both verbally and in writing. Any work in which untested or unaccepted materials are used shall be ordered removed and replaced at the permittee's expense. Any required corrective work shall be made at the permittee's expense and shall be done to the satisfaction of the Engineering Department. If immediate corrections are not made, further project construction shall be stopped.
- E. In determining whether or not the access work done by the permittee is acceptable, the Engineering Department may consult with the Road & Bridge Department. If a determination is made that testing is required, the number and location of the tests shall be determined by the Engineering Department. If the Engineering Department determines testing by an independent lab is necessary, the cost of such testing shall be paid by the permittee.

5302.07: Responsibility for Rework on Access Connections

The permittee shall be fully responsible for the maintenance and correction of any faulty construction, including unstable road cuts and chuckholes developed during the construction period and for a period of two (2) years following the final inspection of the access work. All deficiencies shall be resolved to the satisfaction of the Engineering Department. Failure to do so could be cause for denial of future access permits.

5400: RIGHT-OF-WAY PERMIT REQUIREMENTS

5401: Purpose and Intent

Right-of-way permits shall be obtained whenever a developer, contractor, property owner, utility company or other individual proposes to install utility lines, culverts or any other work requiring signage or disturbance within County rights-of-way or recpath easement(s). Utilities include water, sewer, natural gas, telephone, electrical and television cable lines. Right-of-way permits are required to assure the method of installation meets the specifications in these regulations and adequate revegetation of disturbed areas outside the roadway is completed. They are also intended to assure adequate reconstruction and/or repair of any damage caused to County roads or road right-of-way or recpath easement.

5402: Requirements for Financial Guarantee

- A. Any permittee proposing to install utility lines or culverts in County road rights-of-way, or recpath easement may be required to secure to the County a financial guarantee for the total amount required to restore public property. The amount of the guarantee shall be based on contract prices for performing such work, as specified and approved by the Road & Bridge Director or his authorized representative. If the work and installation are not completed as stated and in accordance with the standards and specifications determined by the Road &

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

Bridge Director or his authorized representative, the County shall give written notice of the defects to the permittee at least 30 calendar days prior to the expiration date of the financial guarantee. The notice shall also state that the financial guarantee will be called unless satisfactory corrective work is done within 20 calendar days of the notice. If satisfactory corrective work is not done within the required time limit, the work shall be in default and the County shall call the financial guarantee.

- B. The Road & Bridge Director or his authorized representative may waive or impose the requirement for a financial guarantee for any permittee at their discretion.

5403: Procedures/Requirements for Issuance of Right-of-Way Permits

The following procedures must be followed and requirements met in the review of applications for right-of-way permits.

5403.01: Submittal Requirements for Right-of-Way Permits

The following information must be submitted with any application for a right-of-way permit, unless specific items are waived by the Road & Bridge Director or his authorized representative as unnecessary.

- A. Fee as required by resolution of the BOCC.
- B. Completed permit form.
- C. For minor installations, sketch plan showing the following:
 - 1. Location of all excavations using dashed lines.
 - 2. Location of road and road right-of-way, or rectxh easement.
 - 3. Location of any driveways.
 - 4. Existing structures, if any.
 - 5. Proposed structures including any garages.
- D. For major installations, construction plans and specifications.
- E. Construction schedule.
- F. A traffic control plan developed in conformance with the most recent edition of the MUTCD.
- G. Evidence of valid contractor's license.
- H. Financial guarantee covering the cost of reconstruction and/or repair of damage caused to any County road, road right-of-way or rectxh easement, if required.
- I. Proof of insurance with minimum coverage of \$1,000,000.

5403.02: Action on Right-of-Way Permits

- A. Applications for right-of-way permits shall be submitted at least three (3) calendar days prior to planned commencement of construction for minor installations and five (5) calendar days prior for major installations. Construction cannot commence without permit approval. The Road & Bridge Department is responsible for review of applications for right-of-way permits. Consideration shall be given to how the proposed installation affects County road or rectxh maintenance and improvement programs. Right-of-way permits shall not be issued any earlier than May 1st of each year and all right-of-way permit work shall be completed by October 31st of each year. These dates may be changed by the Road & Bridge Director or his authorized representative for good cause so long as the quality of work is not adversely affected.
- B. Approval shall be granted only if the proposed installation meets the specifications in these regulations, the required fee has been paid, and the financial guarantee has been posted if required. Approval of a right-of-way permit may be accompanied by any conditions deemed reasonable by the Road & Bridge Department to insure protection of health, safety and welfare and compliance with these regulations.
- C. The right-of-way permit must be signed by the Road & Bridge Director or his authorized representative for it to be approved.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

5403.03: Construction Specifications and Schedule for Right-of-Way or Recreational Pathway Easement Work

All work undertaken to install utilities or culverts within the County road right-of-way or recpath easement shall conform to the requirements contained in these regulations, and to approved plans and specifications. In issuing right-of-way permits, the Road & Bridge Department shall also approve a construction schedule. The approved construction plans, specifications and schedule cannot be changed without the consent of the Road & Bridge Director or his authorized representative, except in emergency situations as provided in Section 5403.04.

5403.04: Emergencies

If a true emergency exists where time is not available to follow the procedures for obtaining a right-of-way permit or for making modifications to the approved plans, specifications and schedule, an excavator may proceed with right-of-way or recpath easement work after obtaining verbal approval from the Road & Bridge Department.

5403.05: Expiration of Permits

Right-of-way permits expire when the end of the approved construction schedule is reached, and must be renewed in advance to prevent the County from calling any financial guarantee posted by the permittee, stopping work on a project, or cancelling subsequent inspections.

5404: Fines and Penalties

Any work performed in the public right-of-way without the required permit is subject to enforcement as set forth in Chapter 14 of this Code. The Road & Bridge Department reserves the right to deny permits to any contractor based on a history of non-compliance with these regulations.

5405: Procedures for Road or Recreational Pathway Closures During Right-of-Way or Recreational Pathway Easement Work

Road or recpath closures to accommodate right-of-way or recpath easement work are not permitted unless justified on the basis of overall benefit to the general public. Refer to Section 5202 et seq. for specific requirements to road or recpath closures. Requests for road or recpath closures shall be specified on the permit form submitted by the applicant, and no road or recpath closures shall be undertaken unless approved by the Road & Bridge Director (and/or the Open Space & Trails Department, if applicable) in conjunction with the right-of-way permit issued by the Road & Bridge Department. When road or recpath closures have been approved, the permittee shall use the following procedures:

- A. At least five (5) calendar days prior to actual closure, the permittee shall obtain approval from the Road & Bridge Department of a detailed traffic control plan. This plan must be based on the current CDOT "S" Standards and in compliance with Part 6 of the MUTCD. In addition, at least five (5) calendar days prior to actual closure, the permittee shall verify the schedule and location of road or recpath closures.
- B. On the day of the anticipated closure, but prior to the installation of any devices in the right-of-way, the Summit County Communications Center must be notified so that the appropriate fire district, school district, and the County Sheriff's office can be notified of any impacts to access.
- C. Road or recpath closures are only permitted between the hours of 7:30 a.m. and 5:30 p.m., unless authorized otherwise by the Road & Bridge Department. Where closures of more than one (1) day are approved, a suitable detour must be provided, and must be marked and signed to accommodate night traffic.

5406: Protection of Public Safety and Convenience

The permittee shall at all times conduct right-of-way or recpath easement work in a manner which ensures the least possible obstruction and hazard to the traveling public. The permittee shall provide for the safety and convenience of the residents along roads or recpath where work is being done, and for the protection of persons and property at

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

all times. Adequate warning signs, barricades, lighting, flags and other devices as specified in Part 6 of the most recent edition of the MUTCD and the CDOT “S” Standards and, as approved by the Road & Bridge Department, shall be provided, maintained and paid for by the permittee. Flagmen shall be posted to guide the traveling public where only one (1) traffic lane remains open or through otherwise unsafe operations. Prior to approval of the right-of-way permit, a traffic control plan shall be submitted to the Road & Bridge Department for approval.

5407: Construction Procedures for Right-of-Way or Recreational Pathway Easement Work

The permittee shall plan right-of-way or recpath easement work so it does not create safety hazards or maintenance problems, render portions of right-of-way or recpath easement unusable for future road improvement or obstruct flood flows.

5407.01: Compliance with Safety Standards

The permittee’s operations shall conform to the applicable requirements established by the Industrial Commission of Colorado and the Federal Occupational Safety and Health Act (“OSHA”).

5407.02: Staging of Installations

Staging of utility installations may be required by the Road & Bridge Department to produce the least disruption possible for the traveling public. A permit for any subsequent stages may not be issued until the prior stage has satisfactorily progressed or been completed.

5407.03: Installation of Utilities

All utilities shall be installed in accordance with the plans and specifications approved by the utility owner and the Road & Bridge Director or his authorized representative. Where applicable, the plans for installation must bear the name, seal and signature of a Colorado licensed Professional Engineer responsible for their preparation. The alignment and method of installation of all utilities within County rights-of-way is subject to approval by the Road & Bridge Director or his authorized representative.

- A. **Underground Utilities:** All accesses to underground utilities from the road surface (e.g. manholes, vaults) shall be of heavy-duty construction capable of safely supporting anticipated maintenance equipment and vehicular traffic. The top of these accesses shall be one (1) inch below the finished grade and be at the same slope of the road.
 - 1. Seep plugs shall be installed in trenches used for underground utilities at no less than 500-foot intervals if the possibility exists that the surrounding water table will be lowered and this will have an adverse effect on surrounding wells and vegetation dependent on the water table elevation.
 - 2. Underground utilities, including but not limited to electric lines, telephone lines, gas lines, cable television/broadband internet service lines, sanitary sewer service lines, water service lines or any other type of utility, shall be installed to the depth specified in the approved plans and specifications for the utility installation, or to a depth of not less than two (2) feet, whichever is greater, when such work is located within the public right-of-way.
- B. **Aboveground Utilities:** Aboveground utilities, whether extending existing or installing new services, will only be allowed by Summit County when there is no practicable alternative. All aboveground utilities shall be located and installed so they do not cause unnecessary obstruction to pedestrian and vehicular traffic or damage to the utility itself that could be harmful to the general public. The minimum overhead clearance shall be 18 feet. No pole or structure above ground shall be placed within a pedestrian walkway nor set closer than ten (10) feet to the shoulder of any County road (see Section 5106.04). In no case will a pole be permitted within ten (10) feet of the travel lane shoulder of a County road, except light and traffic control poles with breakaway bases.
- C. **Utilities in Major Floodways:** All utilities within or adjacent to major floodways shall comply with the Summit County Floodplain Regulations, and shall be located and installed in a manner that will prevent objectionable damage such as land erosion, water pollution or flood diversions.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

5407.04: Trenching, Backfill and Reconstruction of Road or Recreational Pathway Surfaces

The method used in trenching for underground utilities and for backfilling trenches shall comply with the requirements of these regulations (Section 5203.05). Jetting of backfill is not permitted within County roadways or recpaths. Upon completion of installation, the roadway or recpath shall be reconstructed using the specifications contained in these regulations for subbase preparation, base course materials, thickness and compaction and final surfacing so as to restore the roadway to current construction standards for that type of road or recpath.

- A. **Gravel Roads:** Suitable material excavated from trenches may be used for backfill subject to approval of the Road & Bridge Department. At no time shall contaminated, wet, soggy, frozen or other unsuitable material be used as backfill. If proper backfill is not available at the site, suitable material shall be imported and unsuitable material removed from the site. Backfill shall extend to the subgrade of the road or to natural ground (see Figure 5-8).
- B. **Paved Roads or Recreational Pathways:** All cuts made in asphalt or concrete surfacing shall be made by mechanically cutting a transverse vertical cut, and the width of pavement removed shall be one (1) foot wider than the edges of the trench or the excavated area.
 - 1. All excavations made in paved streets or recpaths shall be completely restored within fifteen calendar days. In the event weather conditions preclude restoration by permanent hot bituminous pavement, temporary repairs may be made by tamping and rolling into place cold mix asphalt. Such cold mix patches shall be removed and replaced by a permanent hot bituminous pavement within 30 calendar days or as weather and availability of materials permit.
 - 2. The final pavement cut shall not be made until immediately prior to patching.
 - 3. Permanent hot mix patches shall be no less than three (3) inches in thickness or not less than the thickness of the pavement adjacent to the excavation, whichever is thicker.
 - 4. Permanent patches shall be installed in accordance with Section 5203.09 and with the following:
 - a. When a utility patch is located within a single roadway lane, the existing asphalt shall be cut from centerline of the road, transversely to the outside edge of asphalt of the lane containing the utility patch, and replaced with Hot Mix Asphalt of the type specified in the approved plans and specifications.
 - b. When a utility patch is located within two roadway lanes, the existing asphalt shall be cut transversely across the full width of the roadway, and replaced with Hot Mix Asphalt (HMA) of the type specified in the approved plans and specifications.
 - c. Infrared pavement patching may be substituted as an approved alternate construction method for 1 and 2 above. However, infrared pavement patching will be required for all pavement patches on recpaths and when the existing asphalt surface is less than three (3) years old.
 - 5. Damaged pavement shall be repaired by appropriate methods as approved by the Road & Bridge Department. In general, cracks shall be filled with the proper asphalt hot bituminous pavement product and the surface seal-coated. An overlay, the full width of the paved surface, shall be required in those instances where, in the opinion of the Road & Bridge Director or his authorized representative, riding quality, safety or appearance of the finished roadway or recpath has been impaired. Subgrade failures caused by the permittee's operation of heavy equipment shall be rectified by reconstructing the subgrade layers and replacing the subbase, base and paving. The Road & Bridge and/or the Engineering Department may at their discretion require independent verification to confirm any results published in reports furnished upon completion of the work.

5408: Inspection and Testing of Right-of-Way or Recreational Pathway Easement Work

- A. Adequate inspections ensure compliance with County requirements and are the basis for release of maintenance responsibility and/or for release of any financial guarantee. It is the responsibility of the permittee to contact the Road & Bridge Department one (1) day in advance of required inspections. In-progress inspections of all elements of work will eliminate the need for extensive post-testing. At least one (1) inspection at the conclusion of right-of-way or recpath easement work is required. In making this inspection, the Road & Bridge Department shall check for compliance with these regulations and approved plans, and also for adequate cleanup of roadway surfaces and the right-of-way or recpath easement.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

- B. Any work or material which does not conform to these regulations, any pavement failures or broken asphalt, damaged signs or fencing, any remaining debris either in the roadway or adjacent property, or improper drainage, shall be brought to the attention of the permittee both verbally and in writing. Any work in which untested or unaccepted materials are used shall be ordered removed and replaced at the permittee's expense. If immediate corrections are not made, further project construction shall be stopped.
- C. In determining whether or not right-of-way or recpath easement work done by the permittee complies with these regulations, the Road & Bridge Department may consult with the Road & Bridge Director or his authorized representative. If it is decided testing is required to ascertain compliance, the most recent standard methods of AASHTO or ASTM shall be used and conducted by an independent testing firm at the permittee's expense. If the permittee maintains his own testing equipment and qualified personnel, the requirement for an independent testing firm may be waived by the Road & Bridge Director or his authorized representative. Copies of test data shall be furnished to the Road & Bridge Department in a timely manner.

5409: Responsibility for Corrective Work Upon Completion of Right-of-Way or Recreational Pathway Easement Work

The permittee shall be fully responsible for the maintenance and correction of any faulty construction, including unstable road cuts and chuckholes developed during the construction period. The roadway or recpath and roadside or recpath side areas where utility work has been performed shall be thoroughly cleared of all debris and extraneous material and shall be resolved to the satisfaction of the Road & Bridge Department. Failure to do so could be cause for denial of future right-of-way permits or call of the permittee's financial guarantee.

5410: Guarantee Period for Right-of-Way or Recreational Pathway Easement Work

The permittee shall be responsible for a period of two (2) years after completion of right-of-way or recpath easement work for any maintenance or repair necessary to keep the roadway or recpath in an acceptable condition. The County shall retain the permittee's financial guarantee for the guarantee period to insure any required corrective work is done. The permittee may apply in writing to the Road & Bridge Director or his authorized representative for release of a portion of his commitment, and such release may be granted with approval of the Road & Bridge Director or his authorized representative.

5411: Changes Affecting Utilities

Future changes to County roads or recpaths may require the relocation or removal of utility installations. For minor changes, the affected utility company shall complete the relocation or removal within 30 calendar days after notification by the Road & Bridge Department. For major utility relocation projects involving extensive design, securing of contracts or materials orders, the affected utility company shall complete the relocation or removal within 90 calendar days of approval from the Road & Bridge Department for the final design. To avoid the necessity for such changes, utility companies are encouraged to locate their facilities consistent with future plans for County roadways or recpaths.

5500: ROAD ACCEPTANCE AND MAINTENANCE

5501: Purpose and Intent

The purpose of this section is to outline the County's policy regarding road maintenance, including responsibilities of property owners. When road maintenance is contemplated it shall include maintenance of all improvements that are appurtenant to the road being considered within the dedicated road right-of-way or easement. The major components of the maintenance program are snowplowing and sanding, crack sealing, asphalt patching, overlays and replacement, grading of gravel roads and maintenance of drainage ways. In order for maintenance to be done on an efficient basis, roads must be constructed to certain standards of geometric alignment, materials quality and construction quality as described in these regulations. Before the County will maintain any roadway not already accepted for maintenance, a petition must be filed with the BOCC requesting County acceptance of the road for maintenance. A minimum of one (1) year shall elapse between the times the petition is reviewed and, if approved,

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE

CHAPTER 5: Road & Bridge Standards

probationary maintenance can begin. This period of time is due to the budget process time needed to ensure funds are available to maintain the road. This section outlines the acceptance procedure and the conditions that must be met for approval. Acceptance of maintenance of a County road is a quasi-legislative decision of the Board of County Commissioners.

5502: Maintenance Categories

The County categorizes roads based on the type of maintenance they receive. These categories are as follows:

5502.01: Full Maintenance

This category includes roads where the County has an interest of record or other claim to a road, right-of-way or repath easement, the road or repath meets County design and construction standards, the BOCC has accepted the right-of-way or repath, and the road or repath has passed any required probationary period if it has been accepted for maintenance (see Section 5502.02). It also includes roads which may or may not meet current County design and construction standards, but which were dedicated to and accepted by the County for full maintenance before road standards were adopted or enforced. Full maintenance status assigns complete responsibility to the Road & Bridge Department for snowplowing, grading, resurfacing, ditch maintenance and repair as necessary. For snowplowing, priorities are assigned which reflect the use of the road and its relative importance to traffic flow.

5502.02: Probationary Maintenance

- A. When roads are dedicated to the County as public roads, the BOCC may consider probationary maintenance for a two (2) year probationary period provided the roads meet the requirements outlined in Section 5503 et seq.
- B. During this period, any repairs are the responsibility of the property owners or developer seeking final acceptance from the County. The procedures for converting a road from probationary to final acceptance are stated in Section 5506 et seq.

5502.03: Provisional Maintenance

This category includes roads which do not meet current County standards with respect to widths, curves or grades, but which were dedicated to and accepted by the County prior to road standards being adopted or enforced. Such roads may receive limited summer maintenance, but no winter maintenance because snow removal equipment is unable to maneuver on them. This maintenance level is low priority and is dependent on the availability of funds, manpower and equipment.

5502.04: No Maintenance

This category includes any and all public or private roads that are not maintained by the County under any circumstances. Whenever a developer proposes private maintenance of roads within a development, it shall form a new organization of property owners, or annex the development to an existing organization, that will assume financial responsibility for road maintenance. The developer shall also require through covenants or deed restrictions that all property owners within the development join the property owners' organization and assume their share of its financial obligations. Where a new organization must be formed because no existing organization is in close proximity, the developer shall form a metropolitan district, special district, homeowners association or other appropriate organization approved by the County for this purpose.

5503: Assumption of Road Maintenance

When Summit County is petitioned to assume maintenance of a road or roads in the unincorporated portion of Summit County, as outlined in Sections 5504, 5505 and 5506, the following criteria must be considered for the Board of County Commissioners to accept probationary maintenance acting in a quasi-legislative capacity:

- A. The road must be built to current County standards.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

- B. The revenues received and the costs incurred to maintain the road must be considered and found acceptable to the County.
- C. The current and projected build out of the development served by the road must be considered and found acceptable to the County.
- D. The proposal must be consistent with the overall goals, objectives, and budgetary considerations of Summit County in providing safe and efficient maintenance to a majority of the citizens.
- E. The road being considered should provide through access to other public roadways, subdivisions, state highways, or public destinations (e.g. trailheads).

The County shall review each road individually within a development to determine if that road should receive County maintenance.

5504: Acceptance Procedure for Roads and Recpaths Constructed by Developers and Proposed for Acceptance by the County

The County Subdivision Regulations require developers to construct roads necessary to serve approved subdivisions. The following procedure shall be used to determine whether the County will accept roads built by developers for maintenance.

5504.01: Design Review

The developer must obtain approval for the road design from the Engineering Department prior to construction of any road regulated hereunder. The Engineering Department shall determine the road classification, compliance with design criteria and construction standards in these regulations, and adequacy of right-of-way or recpath easement prior to granting approval of the road design.

5504.02: Inspections

At appropriate milestones during construction of the road, the developer's engineer shall request inspection by the Road & Bridge Department and Engineering Department. In order for the road to be considered for probationary maintenance, inspections must occur at the completion of each of the following steps:

- A. Rough grading.
- B. Subgrade preparation.
- C. Placement of road base.
- D. Paving (if applicable).
- E. Construction of drainage improvements (including culverts for driveways, if applicable).
- F. Placement of signs (if applicable).

Failure to schedule any of these required inspections, and any other inspections determined necessary by the County Engineer, shall be grounds for a recommendation of denial for future maintenance requests per Section 5504.04 of this Code. A final inspection shall be conducted after the completion of all improvements. The final inspection shall occur between May and October. Roads must comply with the design criteria and construction standards in these regulations, and with any approved plans. If the inspection discloses any work, in whole or in part, as unsatisfactory, the Road & Bridge Director and/or the County Engineer, or an authorized representative, shall give the developer's engineer the necessary instructions for correction, and the contractor shall comply with and execute such instructions. At the discretion of the County Engineer, the County may withhold the granting of further building permits or any occupancy permits for the project until such time corrective work is completed.

5504.03: Filing Request for County Acceptance

Developers seeking County acceptance for maintenance of roads must submit a letter to the Road & Bridge Department and Engineering Department requesting the BOCC's approval.

**SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards**

5504.04: Staff Evaluation and Recommendation

The Road & Bridge Director or his authorized representative and County Engineer shall determine if the road meets the requirements of these regulations. A recommendation on whether or not probationary maintenance should be provided shall be forwarded to the BOCC as a New Business item at a regularly scheduled BOCC meeting. It is the County's policy to accept roads for maintenance only if they meet the requirements of these regulations and have received design approval and inspection during construction.

5504.05: Board of County Commissioners Action on Request for Acceptance

After the BOCC has received the recommendation from the County Engineer and the Road & Bridge Director, they shall take action by resolution to either grant or deny probationary maintenance of the road as a New Business item during a regularly scheduled BOCC meeting. Such resolution and the probationary acceptance shall expire no later than 30 months from the date of approval by the BOCC.

5504.06: Guarantee Period After Probationary Acceptance

If a road is given probationary acceptance by the BOCC, the developer is responsible for making repairs and correcting failures for a period of two (2) years from the date probationary acceptance is granted. During this two (2) year period, the County will plow those sections of road necessary to serve units that have been built.

5504.07: Final Acceptance

No earlier than 20 months after the BOCC grants probationary acceptance, the developer may request re-inspection of the road. The County Engineer and the Road & Bridge Director or his authorized representative are responsible for re-inspecting and noting any defects or required repairs. The developer shall correct the defects or required repairs. After any defects have been cured and repairs made and 24 months have elapsed since probationary acceptance was granted, the developer may submit a letter to the Road & Bridge Department and the Engineering Department requesting final acceptance of the road. The staff shall make a final recommendation as to whether or not the road should receive full maintenance and forward the recommendation to the BOCC as a Consent Agenda item at a regularly scheduled BOCC meeting.

5505: Acceptance of Private Roads or Recpaths for Maintenance

Summit County will generally not consider maintenance of private roads or recpaths, however, there may be circumstances where a substantial public benefit may exist to justify the County's consideration of maintenance of a private road or recpath. Where it is deemed appropriate to consider maintenance of a private road or recpath in existing subdivisions and developments, the following procedure shall be used for consideration by the County to accept these types of roads for maintenance.

5505.01: Filing Request for County Acceptance

The property owner holding title to a road must submit a letter to the Road & Bridge Department and Engineering Department requesting that the BOCC accept maintenance responsibility for the road. The letter must be signed by all persons, or their authorized representatives, having an ownership interest in the road, which may include the governing board of a homeowners association if duly authorized by the covenants.

5505.02: Staff Evaluation and Recommendation

The County Engineer and the Road & Bridge Director or his authorized representative shall inspect the road to determine whether or not it meets the applicable County criteria and standards in these regulations. It is the County's policy to accept only those roads that meet these requirements. If a road does not meet County standards, the property owners are responsible for improving the road to County standards prior to requesting acceptance. One method for accomplishing road improvements is formation of a LID (see Section 5506). Staff will provide a joint

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

recommendation as to whether or not a road is acceptable for probationary maintenance. This recommendation will be forwarded to the BOCC as a New Business item during a regularly scheduled BOCC meeting.

5505.03: Board of County Commissioners Action on Request for Acceptance

After the BOCC has received the recommendation from the County Engineer and the Road & Bridge Director concerning acceptance of roads for probationary maintenance, they shall take action by resolution to either grant or deny probationary acceptance of the road.

5505.04: Final Acceptance

After the two (2) year probationary period, staff shall make a final determination as to whether or not the road should receive full maintenance and forward the recommendation to the BOCC as a Consent Agenda item during a regularly scheduled BOCC meeting.

5506: Acceptance Procedure for Roads Constructed Through a Local Improvement District

One of the mechanisms available for upgrading existing private or public roads to County standards is the formation of a LID. Under a LID, the County issues tax-exempt bonds to pay for the improvements. Such improvements may include adjusting road grades, widths and alignment, improving drainage, adding road base and/or paving. The cost is assessed against the lot owners who benefit from the improvements.

5506.01: Design and Construction Standards for Local Improvement Districts

Roads constructed through a LID shall meet County standards unless a specific variance is approved by both the Road & Bridge Director or his authorized representative and the County Engineer. Approved variances shall be documented by a resolution of the BOCC adopted at the same time as the district is formed.

5506.02: Construction Supervision for Local Improvement Districts

During construction, the Engineering Department shall be responsible for inspecting work done by the contractor, or shall hire a consultant for this purpose, to ensure the design and construction specifications are met. At the end of construction, the County Engineer and the Road & Bridge Director or his authorized representative shall conduct a walk-through of the project to ensure work has been completed as required.

5506.03: Staff Evaluation and Recommendation

The County Engineer and the Road & Bridge Director or his authorized representative will make a recommendation for acceptance of a completed LID road for full maintenance based upon the criteria set forth in Section 5503.

5506.04: Board of County Commissioners Action on Request for Acceptance

After the BOCC has received the recommendation from the County Engineer and the Road & Bridge Director, they shall take action to either grant or deny full maintenance of the road. The fact that the upgrading of the road was accomplished through a LID does not guarantee acceptance of such road for maintenance. In addition, acceptance shall only be considered if the property owners dedicate the necessary right-of-way or repath easement to the County. If acceptance for full maintenance is granted, any approved variances shall be documented in the resolution of approval. Full maintenance means the County assumes ongoing responsibility for maintenance and plowing.

5507: Responsibilities for Road Maintenance

Private individuals, including property owners, developers, contractors and others have certain responsibilities in the maintenance of County roads, as discussed in the following Sections 5507.01-5507.04.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

5507.01: Providing for Parking

Parking within County rights-of-way is illegal in Summit County, except in areas where it is expressly permitted between May 1st and October 1st by County approved signs. Only licensed, operable motor vehicles, as defined in Section 3815.01 and Chapter 15 of this Code, may park on County rights-of-way where parking is permitted during the summer months. No vehicle may remain parked in the right-of-way for a period longer than 7 consecutive days without being relocated. Permanent storage of motor vehicles in the right-of-way is prohibited. Adequate through access must be maintained in the traveled way at all times. It is the responsibility of every property owner to provide the minimum required off right-of-way parking necessary to accommodate their permitted use(s). Parking shall be prohibited at all times within 50-feet of intersections, as defined in Section 5106.03 of this Code. On-street parking presents particular difficulties during snow plowing season and the Sheriff's Department may order illegally parked cars to be towed at their discretion and the discretion of the Road & Bridge Director or the County Engineer. In addition, a plow operator may, at his discretion, decline to plow all or portions of a road if one (1) or more cars are parked so as to impede plowing.

5507.02: Providing for Drainage

- A. Culverts are required where driveways connect to roadways unless specifically exempted by the Road & Bridge Department and these regulations. It is the responsibility of the property owners to maintain their culverts free and clear of silt, mud, debris and ice at all times. Repair of damage to a road caused by a blocked culvert or lack of a culvert is the responsibility of the property owner. If it becomes necessary for the County to undertake repairs, costs will be billed to the property owner by the Road & Bridge Department as may be authorized by law (see C.R.S. Section 43-5-303 et seq.).
- B. Water that flows out of driveways must be diverted to ditches. Repair of damage to roadways caused by such water is similarly the responsibility of the owner and repair costs will be billed accordingly.

5507.03: Keeping Right-of-Way or Recreational Pathway Easement Clear

Storage of material in any road right-of-way or recpath easement is prohibited. Any material which is stored in the road right-of-way or recpath easement which impedes snow plowing or road maintenance, or which constitutes a hazard to the general public, will be removed by the Road & Bridge Department and the owner billed for the cost of the removal as authorized by Colorado Statutes (C.R.S. Section 43-5-301 et seq.). A 10-foot minimum clear zone shall be maintained at all times between the edge of the traveled way for any road and any fixed obstruction including but not limited to utility poles, retaining walls, boulders, or structures of any kind. No fixed obstructions shall be permitted in this minimum clear zone or additional areas as deemed necessary by the County Engineer or Road & Bridge Director.

5507.04: Repairing Damage

Whenever a property owner, developer, contractor or any other individual undertakes an activity that damages a County road or road right-of-way or recpath easement, they are responsible for restoring the road to at least its original condition. This requirement explicitly includes but is not limited to damage caused by construction activities adjacent to a County road. Ultimate responsibility for assuring that adequate restoration is accomplished lies with the owner of the property where construction is occurring.

5600: VARIANCES FROM DESIGN AND CONSTRUCTION STANDARDS

5601: Circumstances when a Variance may be considered

The County Engineer may, at his discretion, grant a variance from the design criteria and construction specifications contained in these regulations under the following circumstances:

- A. Where, by reason of exceptional topographic or physical conditions or other extraordinary and exceptional situations or conditions, the strict application of these regulations would result in peculiar and exceptional

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

practical difficulties to, or exceptional and undue hardship upon, an individual proposing to construct a road, bridge, recpath or driveway.

- B. For the purpose of reducing environmental damage where an individual is proposing to construct any improvement governed by these regulations (or to which the standards contained herein would apply) and, in the opinion of the County Engineer, the strict application of these regulations would result in excessive cut and fill slopes, visual scarring or other environmental damage.
- C. Additional flexibility from the design criteria and construction specifications of this Chapter may be granted for projects undergoing a rural land use process, as specified in Section 8420 et seq. The flexibility may be granted by the County Engineer consistent with the intent of limiting visual and environmental impacts potentially caused by road or recpath construction, provided safe access for motor and emergency vehicles is ensured.
- D. Relief will not result in substantial detriment to public health, safety and welfare, substantial impairment of the road or recpath design and construction standards or the granting of any special privilege or use.

5602: Considerations for Decision on Variances

Variances under this section 5600 shall be processed as a Class 2 Development Review. In reviewing **all requests for variances**, the County Engineer shall consider the following:

- A. The effect of using a lesser standard on public health and safety including the ability of emergency vehicles to gain access using the road(s), bridge(s), recpath(s) or driveway(s) built to a lesser standard.
- B. The severity of the terrain crossed by the road alignment.
- C. The availability of alternative alignments where the same or more stringent standards could be met with the same or less environmental damage.
- D. The length of road or recpath segments which will be built to a lesser standard.
- E. The amount of snowfall anticipated and degree of exposure of the road or driveway surface to sun.
- F. Comments from other agencies received during the referral period.

5700: ENFORCEMENT OF DESIGN AND CONSTRUCTION STANDARDS

5701: Enforcement when Subdividing Property

Applicants shall submit the required subdivision improvements agreement in accordance with the requirements set forth in the County's Subdivision Regulations contained in Chapter 8 of this Code.

**SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards**

TABLES and FIGURES

TABLE 5-1 Design Capacity for Classes of Roadways

Classification	ADT
Principle Arterial	5000-10000
Arterial	3500-5000
Collector	2000-3500
Local Access	500-2000
Low Volume	100-500
Primitive	Less Than 100

TABLE 5-2 Summary of Road Design Elements

Design Element	Arterial	Collector	Local Access	Low Volume	Primitive
Right-of-Way (min)	100'	80'	60'	50'	40'
Recommended Design Speed (mph)	40-60	35-45	25-35	20-35	20-30
Number of Lanes	2-4	2	2	2	1-2
Min. Lane Width	12'	11'	10'	10'	10'/12' (1)
Shoulders	6'	4'	2'	2'	As Approved
Maximum Sustained Grade	6%	6% (2)	6% (2)	8%	12%
Bridge Width	Per CDOT Bridge Design Manual	32'	26'	24'	Same as Roadway
Design Capacity (adt)	5000	3500	2000	500	100
<p>(1) For roads having one lane, lane must be 12' wide; for roads having two lanes, each lane must be 10' wide. (2) See Section 5103.03(A)(2)(b) for exceptions. (3) Back Country Roads shall be designed according to the standards, guidelines and procedures in Section 3514.03</p>					

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

TABLE 5-3 Minimum Structural Sections

Road Class	Gravel	Paved
Primitive	3" Base Course 3" Sub base	Not Applicable
Low Volume	3" Base Course 3" Sub base	3" Asphalt 3" Base course 3" Sub base
Local Access	4" Base Course 4" Sub base	3" Asphalt 3" Base course 3" Sub base
Collector	Not Applicable	4" Asphalt 4" Base Course 4" Sub base
Arterial	Not Applicable	6" Asphalt 4" Base Course 4" Sub base
Shared Use Path/Trail	Not Applicable	3" Asphalt 3" Base Course 3" Sub base
<ul style="list-style-type: none"> • Full depth asphalt or concrete designs will be considered and may be used with approval of the County Engineer • Sub base may be substituted with road base with prior approval 		

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

TABLE 5-4 Coefficient of Runoff

Type of Surface	Vegetation Density	Value of C= (Rainfall)
Roofs		.97
Pavements		
Concrete or Asphalt		.97
Gravel from clean and loose, to clayey and compact		.60
Earth Surfaces		
Sand from uniform grain size, no fines to well graded, some, clay or silt	Bare	.60
	Light Vegetation	.45
	Dense Vegetation	.35
Clay, from coarse sandy or silty, to pure colloidal clay	Bare	.70
	Light Vegetation	.50
	Dense Vegetation	.40

TABLE 5-5 Maximum Permissible Velocities

Channel Material	"n"	Velocity (feet/sec)
Lines or well established grass	.05	5
Bunched grasses with exposed soil	.04	3
Fine sand or silt	.02	1
All other bare soils	.03	2

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

TABLE 5-6 Driveway Criteria

Type of Service	Minimum Driveway Width	Opening Width (including flares)		Minimum Centerline Radius of Curvature
		Minimum	Maximum	
COMMERCIAL	22 feet	24 feet	*	65 feet
RESIDENTIAL				
Single-Family				
< 200' in length	12 feet	18 feet	24 feet	N/A
> 200' in length	14 feet	18 feet	24 feet	40 feet
Serving two to four units				
< 200' in length	14 feet	20 feet	30 feet	N/A
> 200' in length	16 feet	20 feet	30 feet	40 feet
Multi-family	22 feet	24 feet	30 feet	65 feet

TURNOUT SPACING FOR DRIVEWAYS	
LENGTH	TURNOUTS (8' x 30')
< 400 feet	None
400 - 800 feet	One turnout at midway point of driveway
>800 feet	Every 400 feet
DRIVEWAY TURNAROUNDS FOR EMERGENCY EQUIPMENT	
LENGTH	TURNAROUNDS
RESIDENTIAL	
< 400 feet	None
> 400 feet	One to within 150 feet of dwelling unit
MULTI-FAMILY, INDUSTRIAL, COMERCIAL	One turnaround as specified in Figure 5-6 if the driveways dead end

*To be determined at time of site plan review.

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

TABLE 5-7 Gradations for Gravel Roads

Standard Sieve Size	% Passing by Weight
Sub base Course	
1-1/2"	100%
1"	95-100%
No. 4	30-70%
No. 200	5-12%
Top Course	
3/4"	100%
No. 4	30-60%
No. 8	25-55%
No. 200	8-15%

Note: Aggregate mixtures for gravel roads shall have a liquid limit of no greater than 30 and a plasticity index between 4 and 10 when the aggregate is tested in accordance with AASHTO T-89 and T-90, respectively.

TABLE 5-8 Gradations for Base Course Material

Standard Sieve Size	CDOT Class 5 (% Passing)	CDOT Class 6(% Passing)
1-1/2"	100%	--
1"	95-100%	--
3/4"	--	100%
No. 4	30-70%	30-65%
No. 8	--	25-55%
No. 200	3-15%	3-12%

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

TABLE 5-9 Minimum Discharge and Delivery Temperatures

Asphalt Grade	Minimum Mix Discharge Temperature, °F ¹	Minimum Delivery Mix Temperature, °F ²
PG 58-28	275	235
PG 58-22	280	235
PG 64-22	290	235
AC-20 (rubberized)	320	280
PG 76-28	320	280
PG 70-34	300	280
PG 64-28	300	280
PG 58-40	300	280

¹ The maximum discharge temperature shall not exceed the minimum discharge temperature by more than 30° F

² Delivered mix temperature shall be measured behind the paver screed.

TABLE 5-10 Minimum Air and Surface Temperatures

Compacted Layer Thickness In Inches	Minimum Air and Surface Temperature, °F			
	Top Layer		Layers Below Top Layer	
	Note (1)	Note (2)	Note (1)	Note (2)
1" or Less	60	70	50	60
1" to 3"	50	60	40	50



Notes: Air Temperature is taken in the shade. Surface is defined as the existing base on which the new pavement is being placed.

(1) Temperatures to be used when the mix contains unmodified asphaltic Cement (PG 58-22, PG 58-28, PG 64-22). Temperatures to be used with PG 76-28, PG 70-34, PG 70-28, PG 64-28 PG 58-40 and PG 58-34.

(2) Temperatures to be used when mix contains AC-20R [AC-20 (rubberized)]


SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

FIGURE 5-1 Typical Cross-section of Arterial and Collector Roads

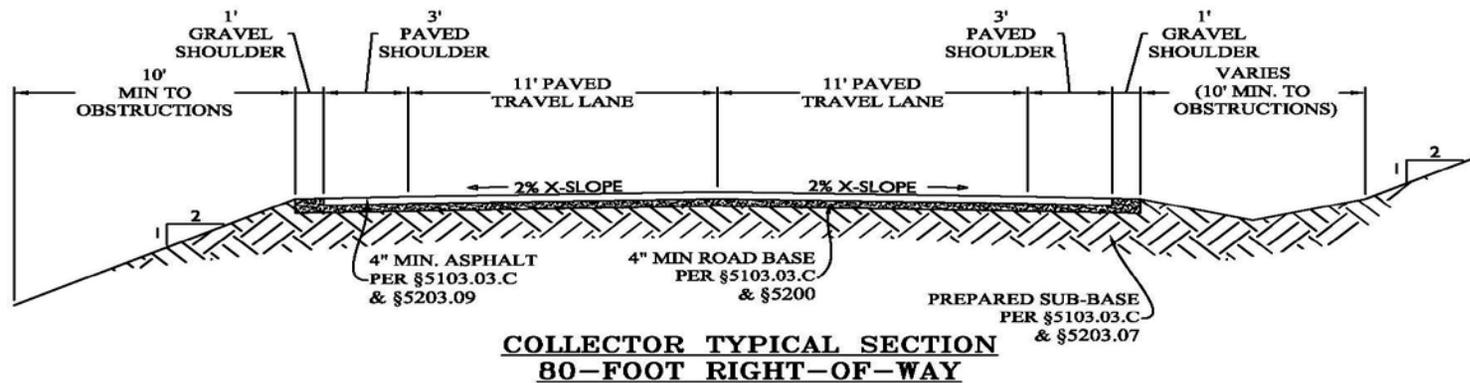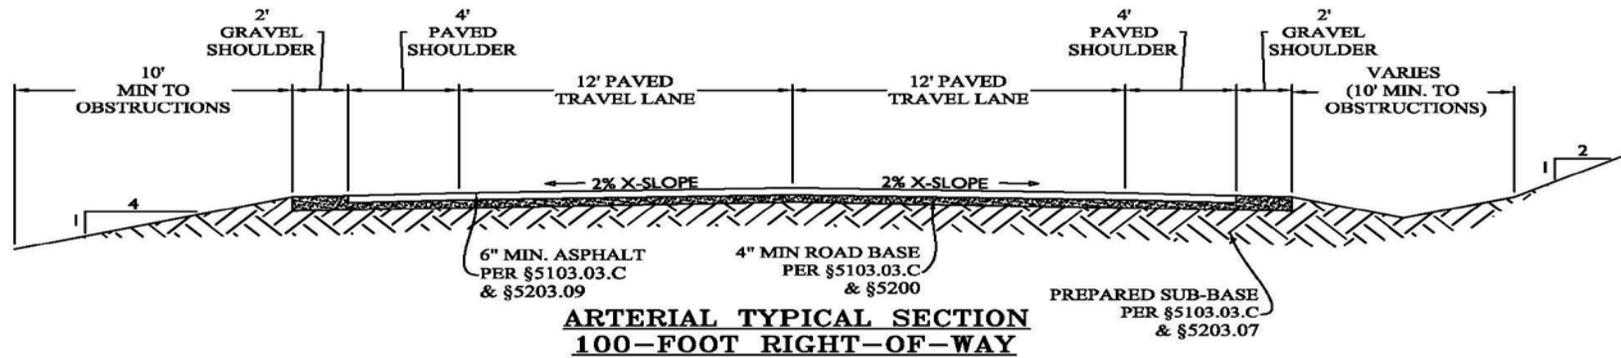


SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

FIGURE 5-2 Typical Cross-sections for Local Access Road

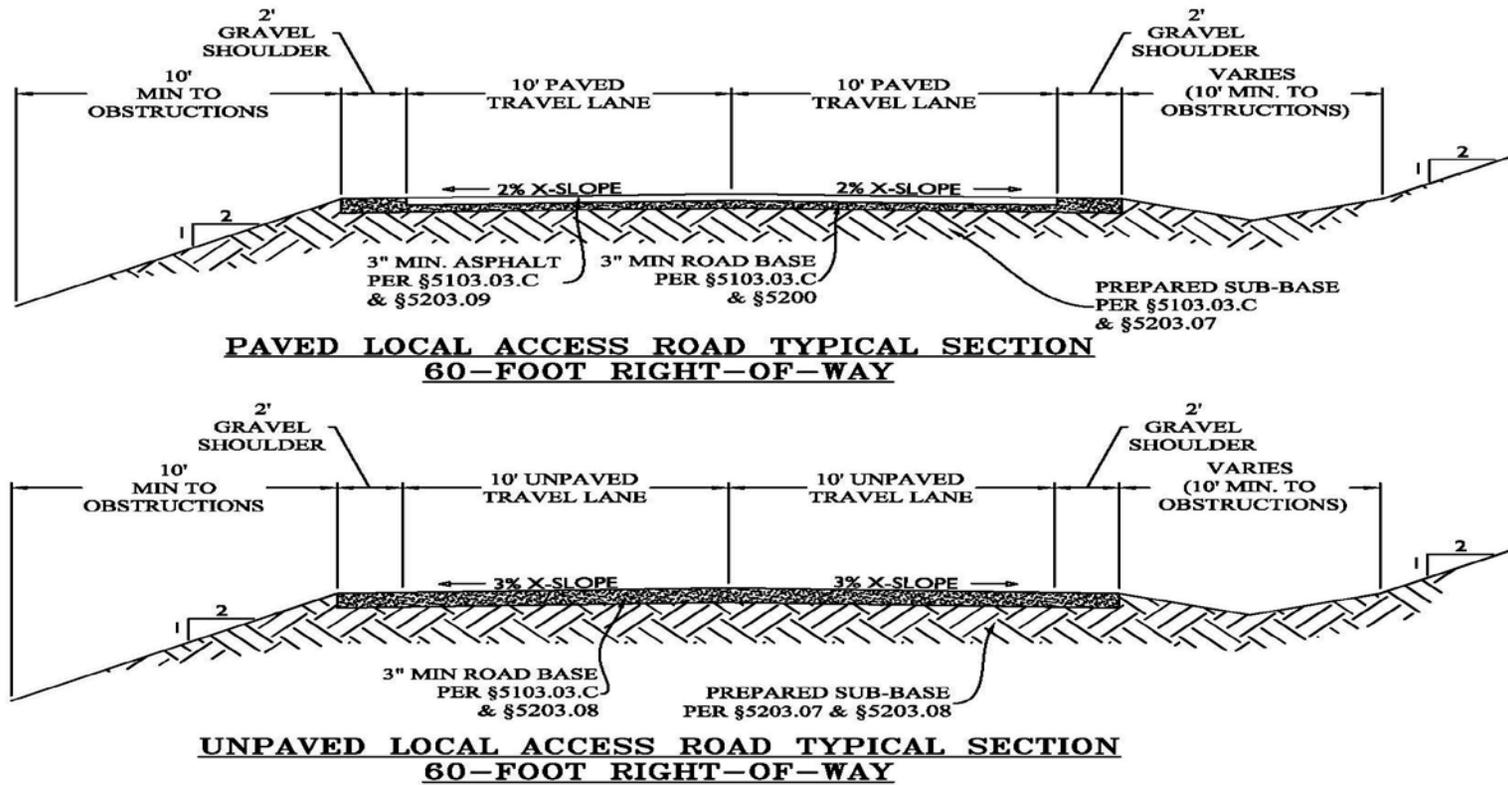


SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

FIGURE 5-3 Typical Cross-sections for Low Volume Roads

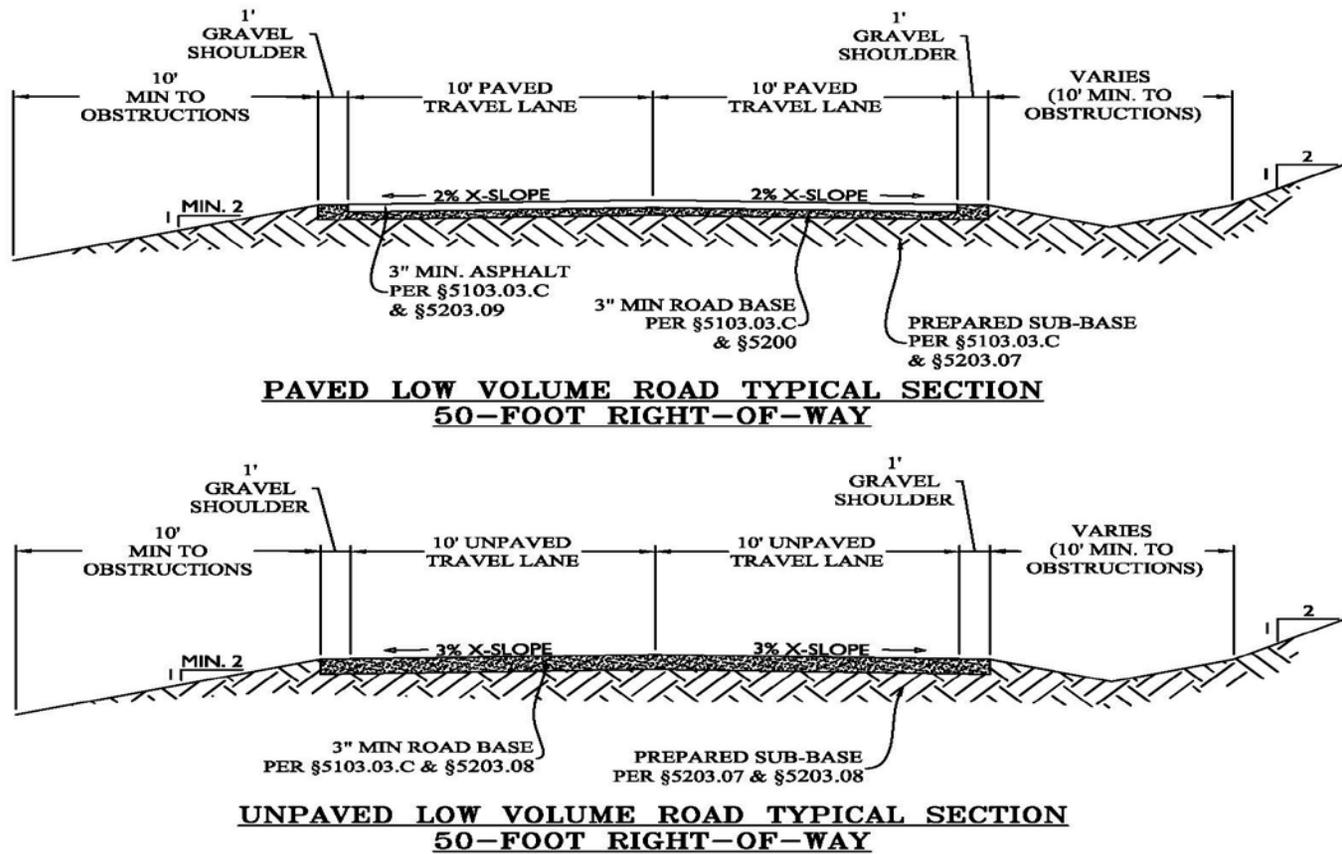


SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

FIGURE 5-4 Typical Cross-sections for Primitive Road

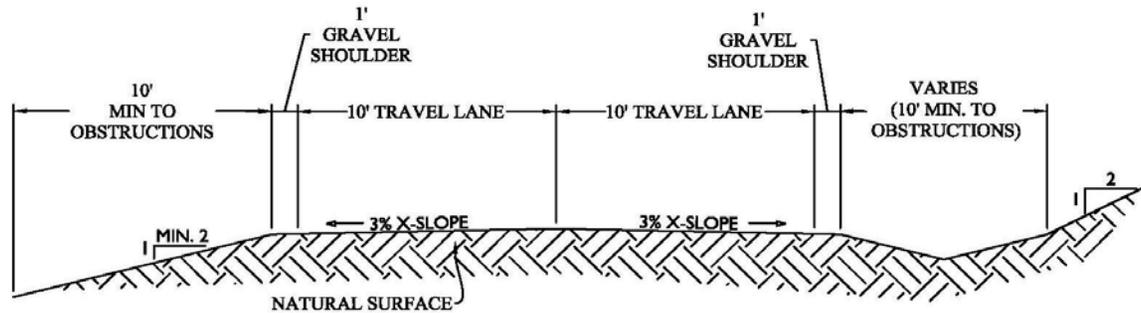

TWO-LANE PRIMITIVE ROAD TYPICAL SECTION
40-FOOT RIGHT-OF-WAY

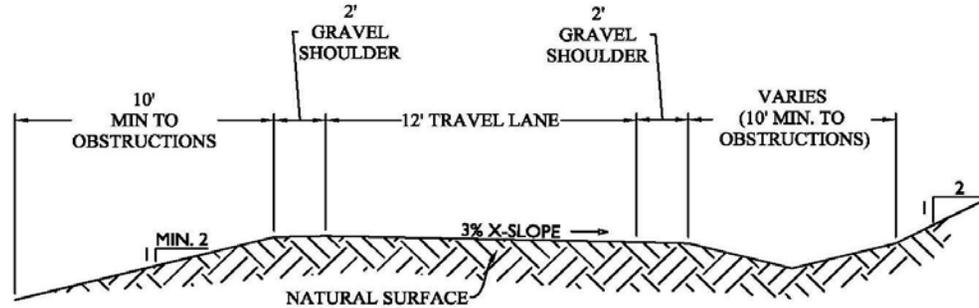


ONE-LANE PRIMITIVE ROAD TYPICAL SECTION
40-FOOT RIGHT-OF-WAY

NOTES

1. TURNOUTS WITH MINIMUM DIMENSIONS OF 30-FEET LONG BY 8-FEET WIDE SHALL BE REQUIRED AT 400-FOOT INTERVALS ON NEW ONE-LANE PRIMITIVE ROADS
2. BACK-COUNTRY ROADS SHALL BE DESIGNED AS NEAR TO THE PRIMITIVE ROAD STANDARD AS IS REASONABLE, WITH EXCEPTIONS BEING ALLOWED TO MINIMIZE VISUAL AND EROSION IMPACTS CAUSED BY LARGE EARTH-MOVING REQUIREMENTS THAT THESE STANDARDS MAY IMPOSE

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

FIGURE 5-5 Typical Section of Recreational Pathway

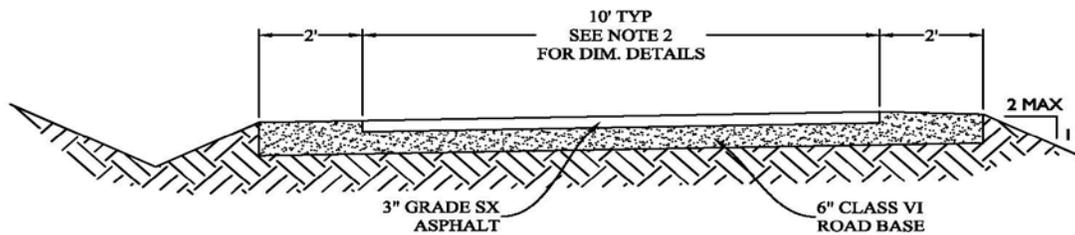


RECREATIONAL PATHWAY TYPICAL SECTION
33-FOOT RIGHT-OF-WAY

NOTES:

1. THE MINIMUM TRAVELED WAY WIDTH ON THE SUMMIT COUNTY RECREATIONAL PATHWAY SYSTEM IS 10-FEET. 12-FOOT WIDE PATHS MAY BE REQUIRED WHERE THE SECTION IS CONSIDERED A PRIMARY ARTERIAL PATHWAY. MINIMUM SHOULDER WIDTHS SHALL BE 2-FEET, EXCEPT THAT WHERE POLES, WALLS, FENCES OR OTHER LATERAL OBSTRUCTIONS EXIST THE SHOULDER SHALL BE A MINIMUM OF 3-FEET WIDE.
2. CROSS-SLOPES ON RECREATIONAL PATHWAYS IN SUMMIT COUNTY SHALL BE A MINIMUM OF 2%, SLOPED TO THE DIRECTION OF LEAST EROSION POTENTIAL, UNLESS OTHERWISE SPECIFIED IN STAMPED ENGINEERED DRAWINGS THAT HAVE BEEN APPROVED BY THE COUNTY ENGINEER AND OPEN SPACE & TRAILS DEPARTMENT.
3. THE SHOULDER OF THE PATHWAY ON THE UPHILL SIDE OF THE CROSS-SLOPE SHALL BE SLOPED AWAY FROM THE PATH TO LIMIT RUN-ON AND EROSION OF SHOULDERS ACROSS THE PATHWAY.
4. A SOIL STERILANT IS REQUIRED BETWEEN THE AGGREGATE BASE COURSE SURFACE AND THE ASPHALTIC CONCRETE PAVEMENT TO PREVENT VEGETATION FROM GROWING THROUGH THE PAVED PATHWAY SURFACE.


SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
 CHAPTER 5: Road & Bridge Standards

FIGURE 5-6 Hammerhead and Cul-de-Sac Typical Minimum Designs

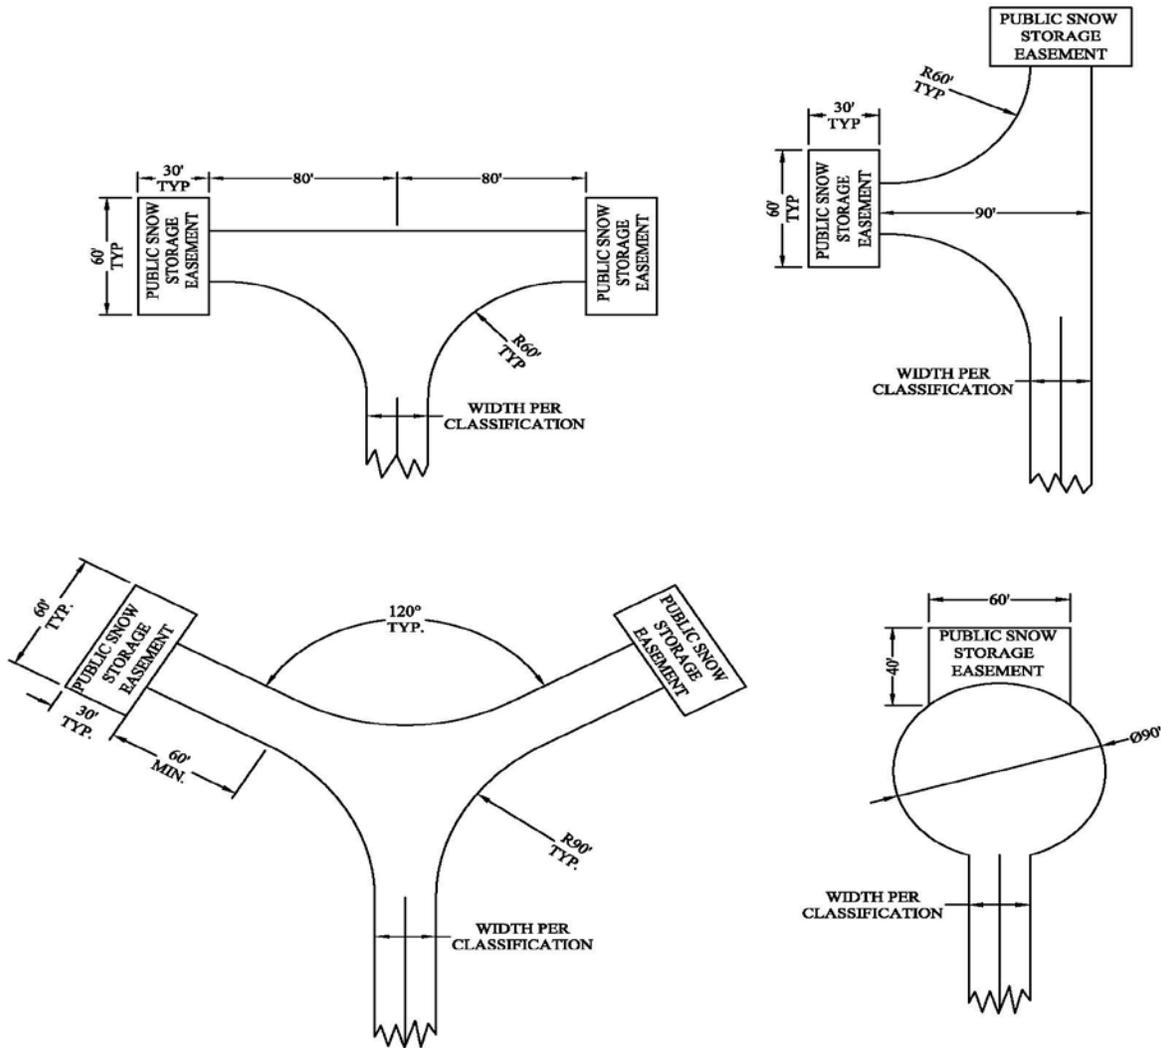


SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

FIGURE 5-7 Sight Distance Triangle

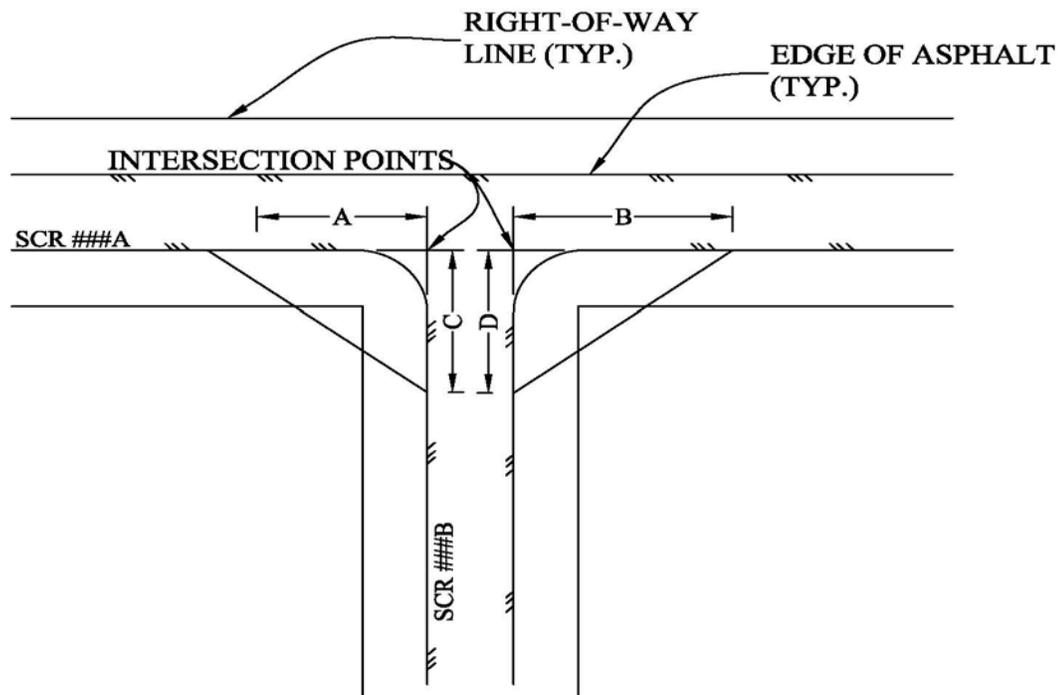

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
 CHAPTER 5: Road & Bridge Standards

FIGURE 5-8 Minimum Requirements for Utility Trench Backfill


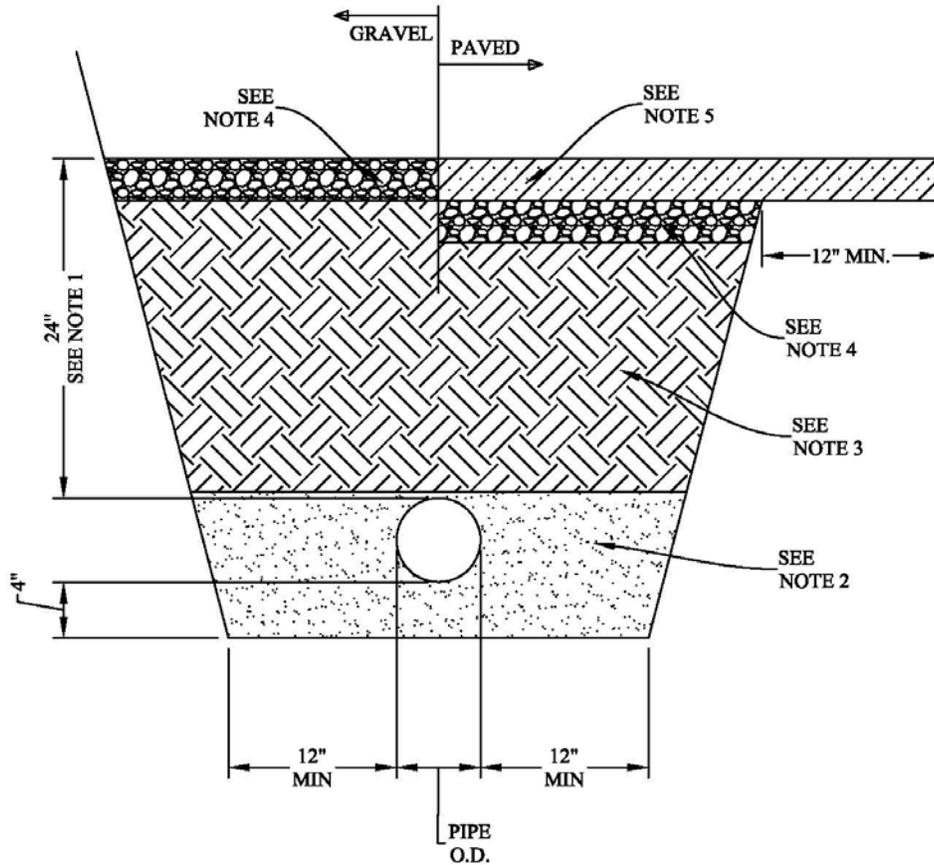


NOTES

1. 24" MIN. DEPTH TO UTILITIES PER COUNTY STANDARDS. OTHER CODES OR UTILITY SERVICE PROVIDERS MAY ESTABLISH A DEEPER REQUIREMENT.
2. BEDDING SHALL BE $\frac{3}{4}$ " MAX Ø SCREENED ROCK.
3. APPROVED BACKFILL PER CODE AND/OR RIGHT-OF-WAY PERMIT COMPACTED TO 95% STANDARD PROCTOR AT OPTIMUM MOISTURE +/-2%.
4. CLASS VI ROAD BASE OR APPROVED ALTERNATE AT A THICKNESS PER THE STANDARDS IN THIS CODE FOR THE ROAD CLASSIFICATION.
5. ASPHALT SHALL BE INSTALLED PER THE STANDARDS IN THIS CODE FOR THE ROAD CLASSIFICATION AT A MINIMUM THICKNESS PER THAT CLASSIFICATION OR MATCHING THE EXISTING PAVEMENT THICKNESS, WHICHEVER IS GREATER.


SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

FIGURE 5-9 Acceptable Culvert Installations

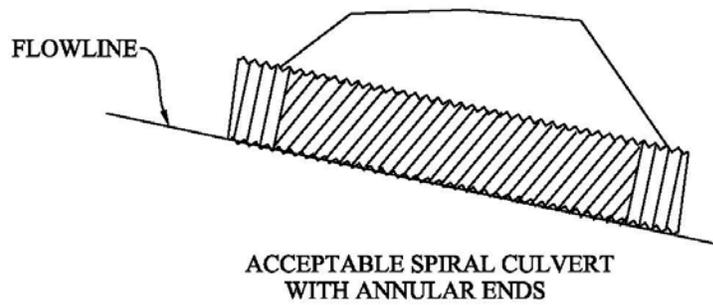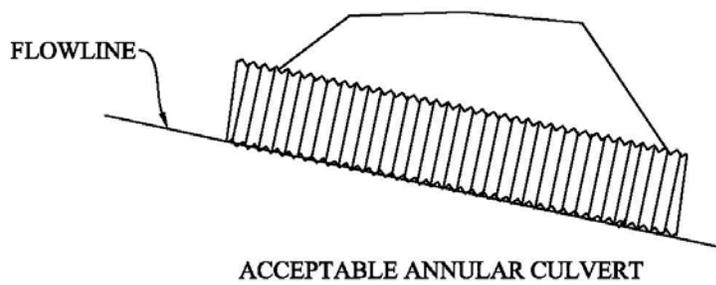

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

FIGURE 5-10 Sample Single Mailbox Approved Design

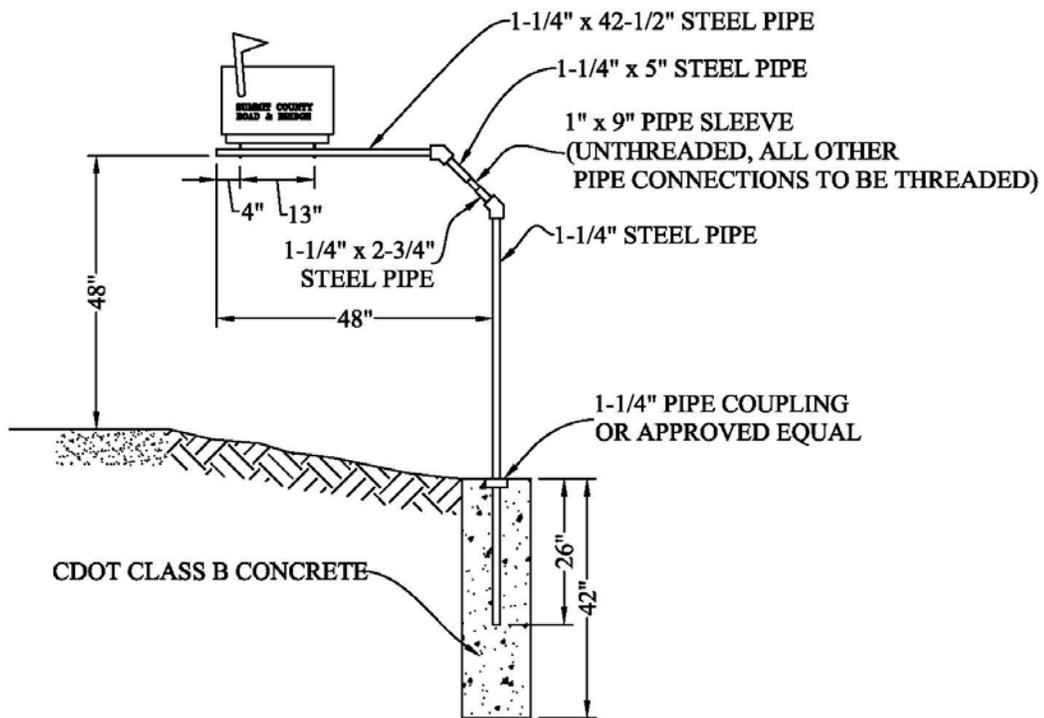

SUMMIT COUNTY LAND USE AND DEVELOPMENT CODE
CHAPTER 5: Road & Bridge Standards

FIGURE 5-11 Typical Drainage Pan Detail

